



Presenter Instructions

- Many of these slides contain animation and graphics
- When reviewing this presentation, you should utilize the “slide show presentation mode” or in the “reading view”
 - This will allow you to become aware of the animation and graphics on the slides
 - Click the “View” in the header, then click “Reading View” in the “Presentation Views” group
- Slides which contain animation will have one or more dots at the bottom left corner of the slide. For example, there are 6 dots at the bottom of this slide
- Each dot represents a “click” which is needed for animation on the slide before the next slide will appear
- With each “click,” as an animation occurs, a dot will also disappear
- When all the dots are gone, the next “click” will take you to the next slide
- Also note, “FCO” will be used to designate the Fire Code Official

Welcome

- Instructor Introduction
- Exits
- Breaks and Schedule
- Cell Phones
- Student Introductions



Description

- This seminar is designed to guide participants through the 2015 IFC requirements related to fire protection systems (Chapter 9)
- These requirements include:
 - Fire sprinkler systems
 - Fire-extinguishing systems
 - Standpipe systems
 - Fire alarm systems
 - Automatic detection systems
 - Smoke control/exhaust systems
- Other fire protection devices and equipment



Goal

- Participants will be able to apply key provisions regarding fire protection systems in the 2015 IFC to aid in code application, administration and enforcement



Objectives

- Upon completion, participants will be better able to:
 - Define key terms
 - Explain why a fire protection system must conform to code criteria and referenced standards
 - Determine where and when fire protection systems are required
 - Explain the principles of how a fire protection system detects and manages a fire
 - Understand the relationship between the code (IFC/IBC) and the referenced standards



Prerequisite Understanding

- Occupancy classifications are based on the use and character of the building
- Many code requirements are based on the occupancy classification



Module 1

Fire Protection Systems

REFER TO

CODE BOOK

Fire Protection Systems

2015 IFC
§202
Page 25

- **Definition of a Fire Protection System:**
Approved devices, equipment and systems or combinations of systems used to detect a fire, activate an alarm, extinguish or control a fire, control or manage smoke and products of a fire or any combination thereof.
- Given this definition, a fire protection system is required to perform certain functions

 2015 IFC and IBC Fire Protection Systems 9

The IFC's Intent for Fire Protection Systems

- When a fire protection system is required, it is:
 - Designed and constructed in accordance with the applicable NFPA standards
 - As modified by the code

- Sprinklers on combustibles balconies in multifamily dwellings – §903.3.1.2.1
- Exempt sprinkler locations – §903.3.1.1.1
- Limited area sprinkler system – §903.3.8

 2015 IFC and IBC Fire Protection Systems 10

The IFC's Intent for Fire Protection Systems

- When a fire protection system is required, it is:
 - Designed and constructed in accordance with the applicable NFPA standards
 - As modified by the code
 - Designed for the respective hazards being protected
 - Inspected and maintained in accordance with the IFC and the applicable standards
 - Modified when the hazard changes and the fire protection system is not capable of controlling a fire

 2015 IFC and IBC Fire Protection Systems 11

Why the IFC Requires a Fire Protection System

- Fire protection systems are required inside or outside of buildings because of:
 - Occupancy classification in the fire area or the building

Group I-2

 2015 IFC and IBC Fire Protection Systems 12

Why the IFC Requires a Fire Protection System

- Fire protection systems are required inside or outside of buildings because of:
 - Occupancy classification in the fire area or the building
 - Occupant load of the fire area or building

Fire area has an OL ≥ 300



Why the IFC Requires a Fire Protection System

- Fire protection systems are required inside or outside of buildings because of:
 - Occupancy classification in the fire area or the building
 - Occupant load of the fire area or building
 - Height or area of the building

Building has a story with OL ≥ 30 and $\geq 55'$ above LLFDVA



Why the IFC Requires a Fire Protection System

- Fire protection systems are required inside or outside of buildings because of:
 - Occupancy classification in the fire area or the building
 - Occupant load of the fire area or building
 - Height or area of the building
 - Quantity of haz mat stored or used inside of a building

Storing or using > 100 lbs pyroxylin plastics



Why the IFC Requires a Fire Protection System

- Fire protection systems are required inside or outside of buildings because of:
 - Occupancy classification in the fire area or the building
 - Occupant load of the fire area or building
 - Height or area of the building
 - Quantity of haz mat stored or used inside of a building
 - Type of hazard stored or used inside of a building

Type IIB dry cleaning operation



Why the IFC Requires a Fire Protection System

- Fire protection systems are required inside or outside of buildings because of:
 - Occupancy classification in the fire area or the building
 - Occupant load of the fire area or building
 - Height or area of the building
 - Quantity of haz mat stored or used inside of a building
 - Type of hazard stored or used inside of a building
 - Fire loss history for specific hazards

Spray application of flammable finishes



Chapter 9 Arrangement

- Chapter 9 is divided into 15 sections, including:
 - 901: General
 - 903: Automatic Sprinkler Systems
 - 904: Alternative Fire-extinguishing Systems
 - 905: Standpipe Systems
 - 907: Fire Alarm and Detection Systems
 - 908: Emergency Alarm Systems
 - 909: Smoke Control Systems
 - 910: Smoke and Heat Removal
 - 914: Fire Protection Based on Special Detailed Requirements of Use and Occupancy
 - 915: Carbon Monoxide Detection

IBC Ch 9 is *almost* identical to IFC Ch 9

Some differences occur in §901



General Provisions §901

Provision	IFC Section	IBC Section
Construction documents	901.2	–
Permits	901.3	–
Installation	901.4	901.2
Modifications	–	901.3
Threads	–	901.4
Acceptance testing	901.5	901.5
Inspection, testing and maintenance	901.6	901.3
Fire areas	901.4.3	901.7
Pump and riser room size	–	901.8
Systems out of service	901.7	–
Removal of or tampering with equipment	901.8	–
Termination of monitoring service	901.9	–
Recall of fire protection components	901.10	–



Construction Documents §901.2

- FCO are authorized to require the submittal, review and approval of design drawings and calculations for fire protection systems
- A contractor's statement of compliance can be required
 - Documents must show that the system complies with the:
 - Plans
 - Applicable standard
 - Manufacturer's instructions



Required vs Nonrequired §901.4.1

- Required fire protection systems must comply with the code and the applicable standards
- Nonrequired fire protection systems must **ALSO** comply with the code and the applicable standards
 - Wherever, any code modification or allowance is made as a result of sprinklers, the system becomes a required system



Additional Fire Protection Systems §901.4.4

- Where the FCO deems a hazard to be of a unique nature or unduly difficult for fire department access, additional fire protection features can be required



Pump and Riser Room §901.4.6

- Pump room or riser room is not required, but, if provided, they must have adequate room for service
 - Following manufacturer's specifications
- Ability to remove largest piece of equipment and reinstall




Fire Pumps §913

- Must meet NFPA 20 requirements
- Pump room maintained >40°F
- Cables and circuits protected by 2-HR construction or UL 2196



Fire Pumps §913

- Must meet NFPA 20 requirements
- Pump room maintained >40°F
- Cables and circuits protected by 2-HR construction or UL 2196



Fire Pumps §913

- Must meet NFPA 20 requirements
- Pump room maintained >40°F
- Cables and circuits protected by 2-HR construction or UL 2196
- IBC §913.2.1: 1-HR separation, 2-HR in high-rise, or ≥50'
- Class II fuel supply is not included in MAQ if it meets IFC §603.3.2

IFC §603.3.2:

- ≤660 gallon
- ≤3,000 gallon if in PAST and room is sprinklered

Installation Acceptance Testing §901.5

- Before a fire protection system can be approved it must be tested
- Fire protection systems must be accepted and approved based on the applicable NFPA fire protection system standards



Photo courtesy of Protection Development Inc.

Systems Out of Service §901.7

- Fire protection system impairment is a critical event that must be reported to the FCO
- Impairment of fire protection systems requires:
 - An individual be designated as the impairment coordinator
 - A plan of action for the impairment

Form No. 11500: FIRE PROTECTION SYSTEM OR COMPONENT OUT OF SERVICE. Includes fields for Tech Area, Floor, Wing, Fire Protection Water Control Valve No., Alarm Initiating Devices, and Description of Impairment.

Systems Out of Service §901.7

- Fire protection system impairment is a critical event that must be reported to the FCO
- Impairment of fire protection systems requires:
 - An individual be designated as the impairment coordinator
 - A plan of action for the impairment

No. 11500
FIRE PROTECTION SYSTEM OR COMPONENT OUT OF SERVICE
 REMOVAL BY AUTHORIZED PERSONNEL ONLY
 ATTACHED TO SYSTEM OR COMPONENT OUT OF SERVICE
 FLOOR AREA: _____ FLOOR: _____ WING: _____
 FIRE PROTECTION WATER CONTROL VALVE NO.: _____
 SYSTEM NO.: _____
 ALARM INITIATING DEVICES: (CHECK ONE)
 PULL STATION: _____ SMOKE DETECTOR: _____ PHOTO-ELECTRIC: _____
 GASTIGHT: _____ LOW AIR SWITCH: _____ ZONE CIRCUIT NO.: _____
 SPONGER SYSTEM: _____ AREA: _____
 RADIANT SYSTEM: _____ COX SYSTEM: _____ FRIEZE: _____
 FIRE PUMP: _____ OTHER: _____
 DESCRIPTION OF IMPAIRMENT:

 AUTHORIZED BY:
 SYSTEM OR COMPONENT OUT OF SERVICE
 DATE: _____ TIME: _____ PAGE: _____
 RESTORED TO SERVICE:
 DATE: _____ TIME: _____ SIGNATURE: _____
 WORK PERFORMED:

 POINT OUTSIDE TREE & VENTILATION:
 1" SUPPLY/1/2" ORAN/1/2" STAIN: _____ FLOW: _____ PSI

Impairment coordinator:

- Responsible for all work
- Notify FD of the status
- Ensure system is restored

Important Terms


- Two important definitions must be reviewed and understood
- Several thresholds for requirements are based on these definitions
 - Level of exit discharge (LED)
 - Fire area



Level of Exit Discharge

- Definition of Level of Exit Discharge :
The story at the point at which an exit terminates and an exit discharge begins.
- A building can have more than one level of exit discharge

Level of Exit Discharge

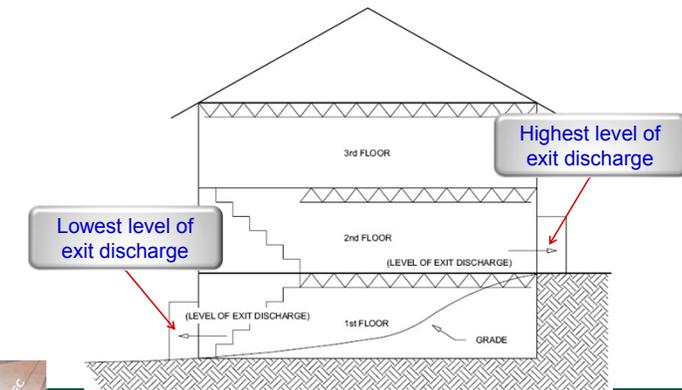

REFER TO

CODE BOOK

2015 IFC
 §202
 Page 24

Fire Area


- Definition of Fire Area:
 The aggregate floor area enclosed and bounded by *fire walls, fire barriers, exterior walls* or *horizontal assemblies* of a building. Areas of the building not provided with surrounding walls shall be included in the fire area if such areas are included within the horizontal projection of the roof or floor next above.



2015 IFC and IBC Fire Protection Systems 33

FOR EXAMPLE


Fire Area Bounded by Exterior Walls

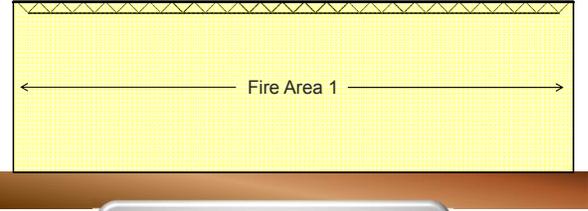


A building constructed with or without fire-resistant materials or assemblies is a fire area

2015 IFC and IBC Fire Protection Systems 34

FOR EXAMPLE



Fire Area Compartmentalized Using Fire Barriers

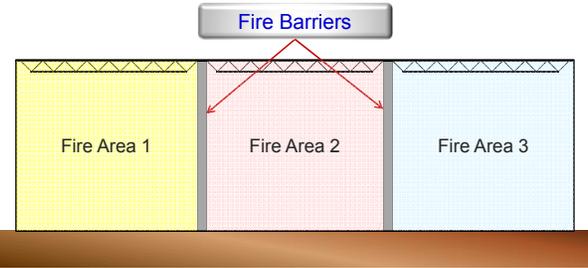





A building divided using fire-resistant assemblies can have one or more fire areas

2015 IFC and IBC Fire Protection Systems 35

Fire Areas in Multistory Buildings

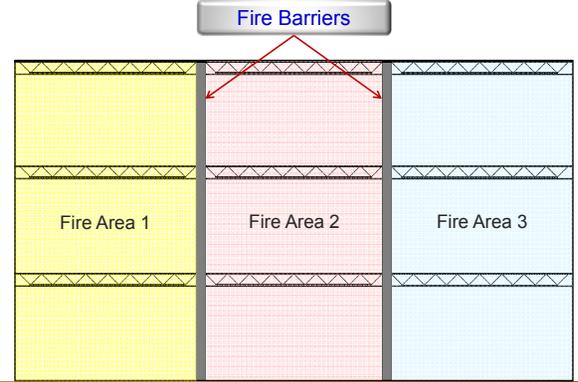

2015 IFC and IBC Fire Protection Systems

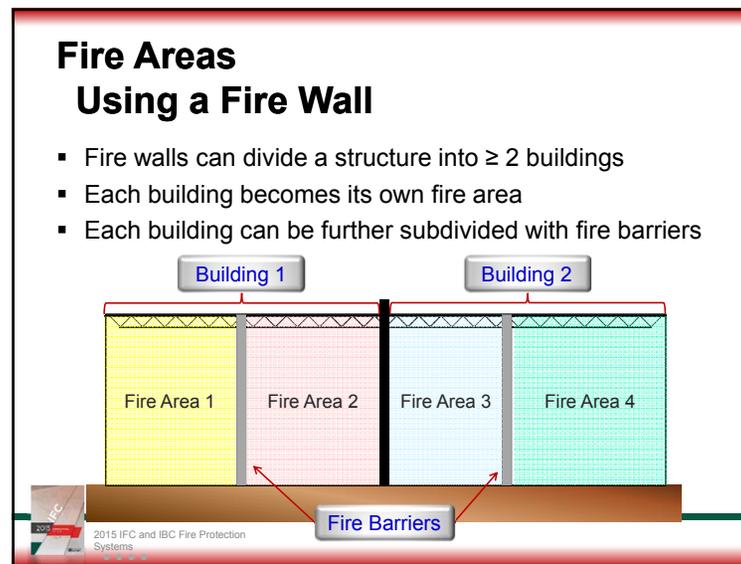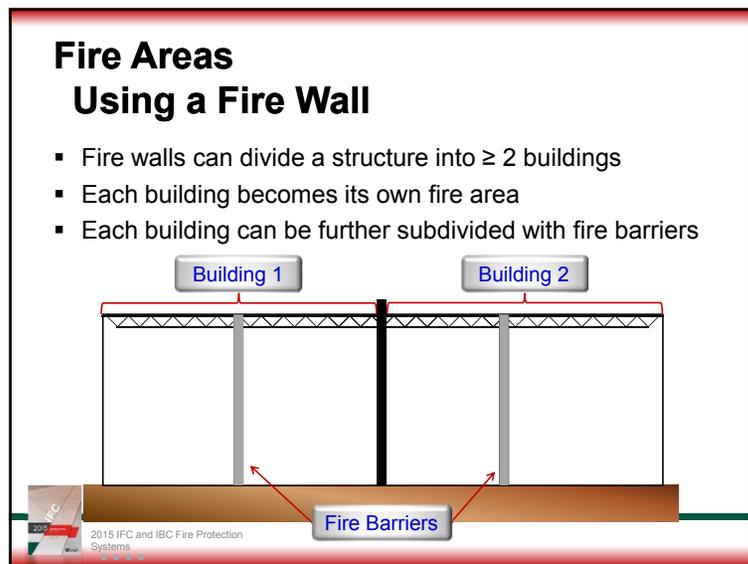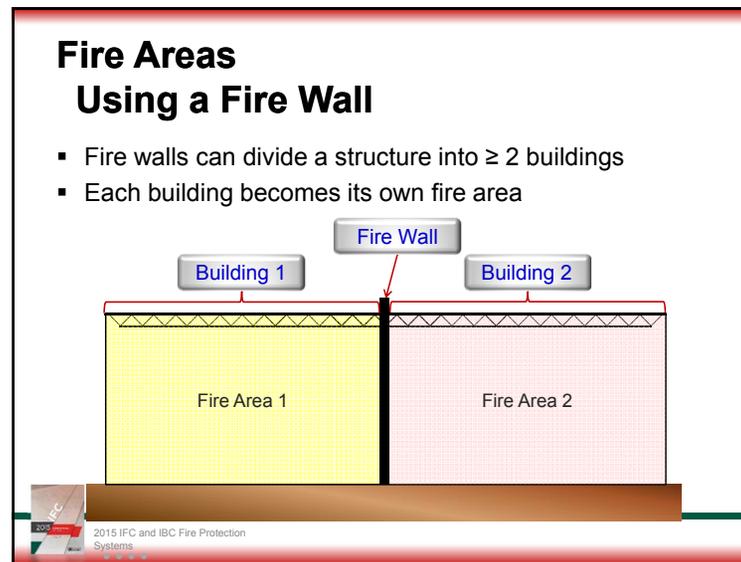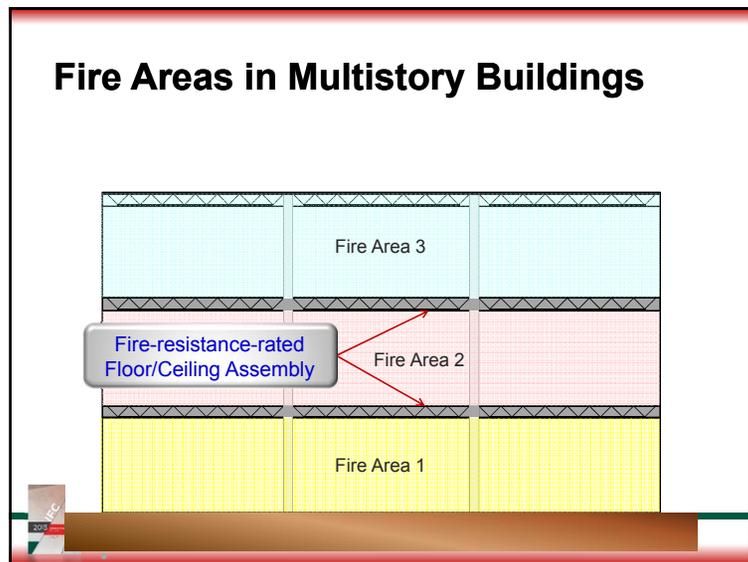

ACTIVITY

How Many Fire Areas?

16,000 square feet
Group B

9,000 square feet
Group B

7,000 square feet
Group A-2

2015 IFC and IBC Fire Protection Systems

REFER TO

CODE BOOK

Fire Area Application

IFC §901.4.3, IBC §901.7

- Fire areas.** Where buildings, or portions thereof, are divided into fire areas so as not to exceed the limits established for requiring a fire protection system in accordance with this chapter, such fire areas shall be separated by fire barriers constructed in accordance with §707 of the IBC or horizontal assemblies constructed in accordance with §711 of the IBC, or both, having a fire-resistance rating of not less than that determined in accordance with §707.3.10 of the IBC.

2015 IFC §901.4.3 Page 103

2015 IFC and IBC Fire Protection Systems

REFER TO

CODE BOOK

IBC Table 707.3.10

Fire-resistance Rating Requirements for Fire Barrier Assemblies or Horizontal Assemblies Between Fire Areas

2015 IBC Table 707.3.10 Page 127

OCCUPANCY GROUP	FIRE-RESISTANCE RATING (hours)
H-1, H-2	4
F-1, H-3, S-1	3
A, B, E, F-2, H-4, H-5, I, M, R, S-2	2
U	1

NOTE: a fire area must be at least 1-HR fire-resistance-rated construction
But in most cases, 1-HR is not adequate

2015 IFC and IBC Fire Protection Systems

REFER TO

CODE BOOK

IBC Table 508.4

Required Separation of Occupancies (hours)

2015 IBC Table 508.4 Page 108

Occupancy Group	A, E		I-1, I-3, I-4		I-2		R ^a		F-2, S-2 ^b , U		B ^o , F-1, M, S-1		H-1		H-2		H-3, H-4		H-5	
	S	NS	S	NS	S	NS	S	NS	S	NS	S	NS	S	NS	S	NS	S	NS	S	NS
A, E	N	N	1	2	2	NP	1	2	N	1	1	2	NP	NP	3	4	2	3	2	NP
I-1 ^a , I-3, I-4	-	-	N	N	2	NP	1	NP	1	2	1	2	NP	NP	3	NP	2	NP	2	NP
I-2	-	-	-	N	N	2	NP	2	NP	2	NP	NP	NP	3	NP	2	NP	2	NP	
R ^a	-	-	-	-	-	N	N	1 ^c	2 ^c	1	2	NP	NP	3	NP	2	NP	2	NP	
F-2, S-2 ^b , U	-	-	-	-	-	-	-	N	N	1	2	NP	NP	3	4	2	3	2	NP	
B ^o , F-1, M, S-1	-	-	-	-	-	-	-	-	-	N	N	NP	NP	2	3	1	2	1	NP	
H-1	-	-	-	-	-	-	-	-	-	-	-	N	NP	NP	NP	NP	NP	NP	NP	
H-2	-	-	-	-	-	-	-	-	-	-	-	-	N	NP	1	NP	1	NP		
H-3, H-4	-	-	-	-	-	-	-	-	-	-	-	-	-	-	1 ^d	NP	1	NP		
H-5	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	N	NP		

2015 IFC and IBC Fire Protection Systems

REFER TO

 CODE BOOK

2015 IBC
 Table 508.4
 Page 108

IBC Table 508.4

Required Separation of Occupancies (hours)

Occupancy Group	A, E		I-1, I-3, I-4		I-2		R ^a		F-2, S-2 ^b , U		B ^c , F-1, M, S-1		H-1		H-2		H-3, H-4		H-5		
	S	NS	S	NS	S	NS	S	NS	S	NS	S	NS	S	NS	S	NS	S	NS	S	NS	
A, E	N	N	1	2	2	NP	1	2	N	1	1	2	NP	NP	3	4	2	3	2	NP	
I-1 ^a , I-3, I-4	-	-	N	N	2	NP	1	NP	1	2	1	2	NP	NP	3	NP	2	NP	2	NP	
I-2	-	-	-	-	-	-	-	-	-	-	NP	2	NP	NP	NP	3	NP	2	NP	2	NP
R ^a	-	-	-	-	-	-	-	-	-	-	2 ^c	1	2	NP	NP	3	NP	2	NP	2	NP
F-2, S-2 ^b , U	-	-	-	-	-	-	-	-	-	-	N	1	2	NP	NP	3	4	2	3	2	NP
B ^c , F-1, M, S-1	-	-	-	-	-	-	-	-	-	-	N	N	-	NP	NP	2	3	1	2	1	NP
H-1	-	-	-	-	-	-	-	-	-	-	-	-	-	N	NP	NP	NP	NP	NP	NP	NP
H-2	-	-	-	-	-	-	-	-	-	-	-	-	-	-	N	NP	1	NP	1	NP	NP
H-3, H-4	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	1 ^d	NP	1	NP	NP
H-5	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	N	NP	NP

Separate Group I-1 from Group M

2015 IFC and IBC Fire Protection Systems 45

REFER TO

 CODE BOOK

2015 IBC
 Table 706.4
 Page 125

IBC Table 706.4

Fire Wall Fire-resistance Ratings

GROUP	FIRE-RESISTANCE RATING (hours)
A, B, E, H-4, I, R-1, R-2, U	3 ^a
F-1, H-3 ^b , H-5, M, S-1	3
H-1, H-2	4 ^b
F-2, R-3, R-4, S-2	2

a. In Type II or V construction, walls shall be permitted to have a 2-hour *fire-resistance rating*.

b. For Group H-1, H-2 or H-3 buildings, also see Sections 415.7 and 415.8

2015 IFC and IBC Fire Protection Systems 46

Design and Installation Requirements §903.3

- Before reviewing the IFC requirements for fire sprinkler systems, it is important to understand:
 - The various standards applicable to fire sprinkler system design
 - The relationship between the code and the standard

2015 IFC and IBC Fire Protection Systems 47

Design and Installation Requirements §903.3

- NFPA publishes 3 standards governing the design, installation, testing and maintenance of fire sprinkler systems:
 - §903.3.1.1 – NFPA 13, *Installation of Sprinkler Systems*
 - §903.3.1.2 – NFPA 13R, *Installation of Sprinkler Systems in Low-Rise Residential Occupancies*
 - §903.3.1.3 – NFPA 13D, *Sprinkler Systems for One- and Two-Family Dwellings and Manufactured Homes*

2015 IFC and IBC Fire Protection Systems 48

Application Matrix of the Sprinkler Design Standards

System Feature	Sprinkler Standard		
	NFPA 13	NFPA 13R	NFPA 13D or IRC §P2904
Extent of Protection	Throughout the building	Occupied spaces	Occupied spaces
Design Intent	Life Safety & Property Protection	Life Safety	Life Safety
Applicability	All Occupancies	Group R up to 4-stories or 60'	1- & 2-family dwellings & Townhomes
Design Methods	Pipe schedule; Control mode – discharge density/design area; Control mode – specific application; Suppression mode	4 sprinklers per compartment	2 sprinklers per compartment
Sprinklers	All listed & approved types	Listed Residential	Listed Residential
Minimum H ₂ O Supply Duration	30 to 120 minutes	30 Minutes	7 or 10 Minutes

2015 IFC and IBC Fire Protection Systems 49



KEY LEARNING

“Installed Throughout”

- IFC Table 1017.2 *Exit Access Travel Distance*, Footnote c
 - Buildings equipped throughout with an automatic sprinkler system in accordance with §903.3.1.1.
- IFC Table 5003.1.1(1) *MAQ per Control Area*, Note d
 - Maximum allowable quantities shall be increased 100 percent in buildings equipped throughout with an approved automatic sprinkler system in accordance with §903.3.1.1.
- IBC Table 506.2 *Allowable Area*, Note S1
 - S1 = Buildings a maximum of one story above grade plane equipped throughout with an automatic sprinkler system installed in accordance with §903.3.1.1

2015 IFC and IBC Fire Protection Systems



KEY LEARNING

“Installed Throughout”

- IFC Table 1017.2 *Exit Access Travel Distance*, Footnote c
 - Buildings equipped throughout with an automatic sprinkler system in accordance with §903.3.1.1.
- IFC Table 5003.1.1(1) *MAQ per Control Area*, Note d
 - Maximum allowable quantities shall be increased 100 percent in buildings equipped throughout with an approved automatic sprinkler system in accordance with §903.3.1.1.
- IBC Table 506.2 *Allowable Area*
 - S1 = Buildings a maximum of one story above grade plane equipped throughout with an automatic sprinkler system installed in accordance with §903.3.1.1

What does “equipped throughout” or “installed throughout” mean?

2015 IFC and IBC Fire Protection Systems



KEY LEARNING

“Installed Throughout”

- Under the design of NFPA 13, are **all** areas in the building protected with sprinklers?

NO

- Attic spaces <6” high
- Concealed spaces without combustible construction

2015 IFC and IBC Fire Protection Systems

KEY LEARNING

“Installed Throughout”

- Under the design of NFPA 13, are **all** areas in the building protected with sprinklers?
- Under the design of NFPA 13R, are **all** areas in the building protected with sprinklers?

NO

- Attic spaces without fuel-fired equipment
- Small bathrooms

2015 IFC and IBC Fire Protection Systems

KEY LEARNING

“Installed Throughout”

- Under the design of NFPA 13, are **all** areas in the building protected with sprinklers?
- Under the design of NFPA 13R, are **all** areas in the building protected with sprinklers?
- Under the design of NFPA 13D or IRC §P2904, are **all** areas in the building protected with sprinklers?

NO

- Attic spaces without fuel-fired equipment
- Small bathrooms
- Small closets with noncombustible wall covering

2015 IFC and IBC Fire Protection Systems

KEY LEARNING

“Installed Throughout”

- Under the design of NFPA 13, are **all** areas in the building protected with sprinklers?
- Under the design of NFPA 13R, are **all** areas in the building protected with sprinklers?
- Under the design of NFPA 13D or IRC §P2904, are **all** areas in the building protected with sprinklers?

So which design provides for fire sprinklers “installed throughout”?

2015 IFC and IBC Fire Protection Systems

KEY LEARNING

“Installed Throughout”

- §903.3.1.1 states:
Where the provisions of this code require that a building or portion thereof be equipped throughout with an automatic sprinkler system in accordance with this section, sprinklers shall be installed throughout in accordance with NFPA 13 except as provided in Sections 903.3.1.1.1 and 903.3.1.1.2.

“Installed throughout” means that sprinklers are installed throughout the building in all locations as required by the design standard and the code

2015 IFC and IBC Fire Protection Systems

REFER TO

 CODE BOOK

“Installed Throughout”

903.3.1.1.1 Exempt locations. Automatic sprinklers shall not be required in the following rooms or areas where such rooms or areas are protected with an approved automatic fire detection system in accordance with §907.2 that will respond to visible or invisible particles of combustion. Sprinklers shall not be omitted from a room merely because it is damp, of fire-resistance-rated construction or contains electrical equipment.

1. A room where the application of water, or flame and water, constitutes a
2. A room or space where sprinklers are considered undesirable because of the
3. Generator and transformer rooms separated from the remainder of the
4. Rooms or areas that are of noncombustible construction with wholly
5. Fire service access elevator machine rooms and machinery spaces.
6. Machine rooms, machinery spaces, control rooms and control spaces associated with occupant evacuation elevators designed in accordance with §3008 of the IBC.

Systems

REFER TO

 CODE BOOK

“Installed Throughout”

903.3.1.1.1 Exempt locations. Automatic sprinklers shall not be required in the following rooms or areas where such rooms or areas are protected with an approved automatic fire detection system in accordance with §907.2 that will respond to visible or invisible particles of combustion. Sprinklers shall not be omitted from a room merely because it is damp, of fire-resistance-rated construction or contains electrical equipment.

1. A room where the application of water, or flame and water, constitutes a
- 2.
- 3.
- 4.
- 5.
6. associated with occupant evacuation elevators designed in accordance with §3008 of the IBC.

Systems

- These provisions are not found in NFPA 13
- These provisions are less restrictive than NFPA 13
- §102.7.1 – code provisions take precedence over the standard

ACTIVITY


Fire Protection Systems

Given: 89,000 ft² Group S-1 warehouse. The fire sprinkler system was designed to protect rack storage of Class III commodities in double row racks 24’ high. The original tenant moved out of the building and the new tenant is storing Class IV commodities.

1. What section would apply to ensure the automatic sprinkler system is adequately protecting these new commodities?

Systems

ACTIVITY


Fire Protection Systems

2. Is an anhydrous ammonia detection system in a refrigeration machinery room a fire protection system?
3. Which of the following wall assemblies is **not** a method to separate fire areas?
 - A. Fire wall
 - B. Fire partition
 - C. Fire barrier
 - D. Horizontal assembly

Systems




Module 2
Automatic Sprinkler Systems

Automatic Sprinkler Systems

- NFPA 13 recognizes 4 types of sprinkler systems:
 - Wet-pipe sprinkler system

These systems are designed for use inside buildings with temperatures >40°F

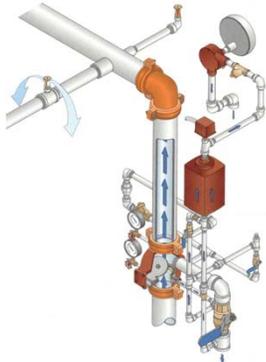

Graphic courtesy of Viking Corp.

2015 IFC and IBC Fire Protection Systems 62

Automatic Sprinkler Systems

- NFPA 13 recognizes 4 types of sprinkler systems:
 - Wet-pipe sprinkler system
 - Dry-pipe sprinkler system

These systems are designed for use inside buildings with temperatures ≤40°F




Graphic courtesy of Viking Corp.

2015 IFC and IBC Fire Protection Systems 63

Automatic Sprinkler Systems

- NFPA 13 recognizes 4 types of sprinkler systems:
 - Wet-pipe sprinkler system
 - Dry-pipe sprinkler system
 - Pre-action sprinkler system
 - Non-interlock

Water enters system upon activation of detection device or sprinkler

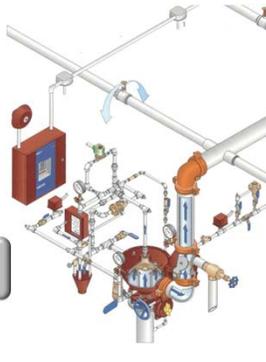

Graphic courtesy of Viking Corp.

2015 IFC and IBC Fire Protection Systems 64

Automatic Sprinkler Systems

- NFPA 13 recognizes 4 types of sprinkler systems:
 - Wet-pipe sprinkler system
 - Dry-pipe sprinkler system
 - Pre-action sprinkler system
 - Non-interlock
 - Single-interlock

Water enters system upon activation of detection device; sprinkler must still activate




Graphic courtesy of Viking Corp.


2015 IFC and IBC Fire Protection Systems
65

Automatic Sprinkler Systems

- NFPA 13 recognizes 4 types of sprinkler systems:
 - Wet-pipe sprinkler system
 - Dry-pipe sprinkler system
 - Pre-action sprinkler system
 - Non-interlock
 - Single-interlock
 - Double-interlock

Water does not enter system until activation of detection device **and** sprinkler

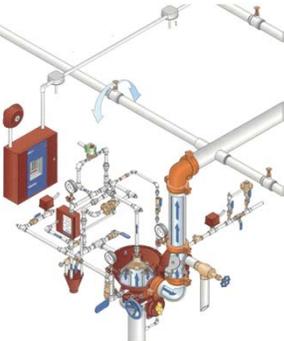


Graphic courtesy of Viking Corp.


2015 IFC and IBC Fire Protection Systems
66

Automatic Sprinkler Systems

- NFPA 13 recognizes 4 types of sprinkler systems:
 - Wet-pipe sprinkler system
 - Dry-pipe sprinkler system
 - Pre-action sprinkler system
 - Non-interlock
 - Single-interlock
 - Double-interlock
 - Deluge sprinkler system

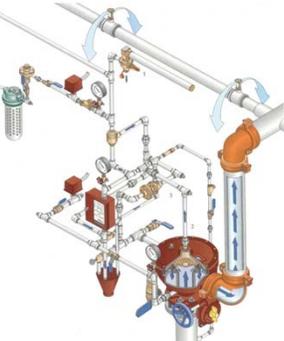

Graphic courtesy of Viking Corp.


2015 IFC and IBC Fire Protection Systems
67

Allowed Increases Based on Fire Sprinkler Systems

Code Section	Modification	NFPA 13	NFPA 13R	NFPA 13D
IBC 504.3 & 504.4	Building Height	Yes	No	No
IBC 506.2	Building Area	Yes	No	No
IBC 507.4, 507.5 & 507.7	Unlimited building area for certain occupancies	Yes	No	No
IFC 503.1.1	Increased distance from building to FD access road	Yes	Yes	Yes
IFC 507.5.1	Hydrant spacing increased to 600'	Yes	Yes	No
IFC 1017.2	Exit access travel distance	Yes	Yes	No
IFC Table 5003.1.1(1) & (2)	100% increase in MAQ for certain hazardous materials	Yes	No	No
IFC Table 5003.11.1	100% increase in the MAQ for nonflammable solid and nonflammable and noncombustible liquid hazardous materials in Group M & S	Yes	No	No
IFC Table 5704.3.4.1	100% increase in the MAQ for flammable and combustible liquids in Group M & S	Yes	No	No


2015 IFC and IBC Fire Protection Systems
68

Allowed Reductions Based on Fire Sprinkler Systems

Code Section	Modification	NFPA 13	NFPA 13R	NFPA 13D
IBC 403.2.1	Reduction in shaft rating in high-rise buildings	Yes	No	No
IBC 404.2	Decorations in, and use of, atriums	Yes	No	No
IBC Table 508.4	Separation of occupancies	Yes	No	No
IBC 705.8.5	Vertical separation of openings	Yes	Yes	No
IBC 708.3	Fire-resistance rating of fire partitions	Yes	No	No
IBC 718.4.2	Draftstopping in attics of Group R-1 & R-2	Yes	Yes	No
IFC Table 803.3	Reduction in flame spread rating for interior finish	Yes	Yes	No
IFC 907.2	Manual fire alarm boxes in Group A, B, E, F, M, R-1, R-2 & R-4	Yes	Yes	No
IFC 1007.1.1	Separation of exits	Yes	Yes	No
IFC Table 1020.1	Corridor walls in means of egress	Yes	Yes	No
IFC 1028.1	Exit discharge	Yes	Yes	No
IFC Table B105.1(1)	50% reduction in fire flow for Group R-3 & R-4 and 1- and 2-family dwellings	Yes	Yes	Yes
IFC Table B105.2	75% reduction in fire flow	Yes	Yes	Yes

Design Criteria in NFPA 13

- Pipe schedule method
- Control mode – density/design area method
 - This includes residential and quick-response sprinklers
- Control mode – specific application method
 - These designs are generally limited to storage applications or special sprinklers
- Suppression mode method
 - Limited to Early Suppression Fast-Response (ESFR) sprinklers




Types of Sprinklers

- NFPA 13 recognizes several different types of sprinklers configured for upright, pendent or sidewall installation
 - Early Suppression Fast-Response (ESFR)
 - Extended Coverage
 - Quick-Response Extended Coverage
 - Quick-Response (QR)
 - Residential
 - Standard Spray
 - Special
 - Specific Application Control Mode



RTI of 6 Sprinklers

- RTI as a function of gas velocity
 - D-P and D-S represent specific models of standard pendent & sidewall sprinklers
 - A and MA represent QR pendent & sidewall sprinklers
 - FR represents a specific QR sprinkler model with conventional frame arms

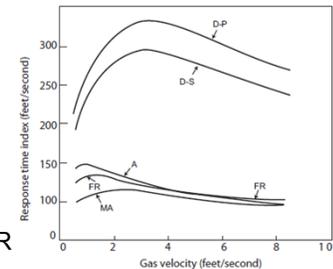

Thompson, Norman J., *Fire Behavior and Sprinklers*, Journal of Fire Protection Engineering, Vol. 15, No. 1, 63-69 (2005)



Special Sprinklers NFPA 13 §8.4.8

- Special sprinklers have been evaluated & listed for performance in specific conditions:
 - Fire tests related to the intended hazard
 - Spray pattern distribution with respect to obstructions and wetting of walls and floors
 - Evaluation of the sprinkler's thermal sensitivity
 - Sprinkler performance under horizontal or sloped ceilings
 - Area of design
 - Allowable clearance to ceilings



Unique Variables of Various Special Sprinklers

MODEL	K-FACTOR	UNIQUE VARIABLES
Tyco EC-25	25.2	<ul style="list-style-type: none"> ❖ If the minimum design pressure is 22 PSIG a minimum 48" clearance between the sprinkler and the stored commodity is required ❖ Ordinary and intermediate temperature sprinklers can be installed using the high temperature rules in Storage applications ❖ Listed for wet-pipe, dry-pipe or pre-action sprinkler systems
Tyco Ultra K17	17.0	<ul style="list-style-type: none"> ❖ The sprinkler spacing is reduced from 12'-0" to 10'-0" when rack storage is introduced
Tyco ESFR	14.0; 16.8; 25.2	<ul style="list-style-type: none"> ❖ Only K=14.0 sprinklers are listed for the protection of Exposed Expanded Group A Plastics
Tyco SW-24 Extended Coverage OH Sidewall	11.2	<ul style="list-style-type: none"> ❖ A minimum clearance of 36" is required between the sprinkler deflector and the top of stored commodities ❖ If installed using a 16'-0" x 24'-0" spacing for an Ordinary Hazard II hazard, the minimum discharge flow rate is 77 GPM



Automatic Fire Sprinklers Data Sheet

- Sprinkler data sheets generally contain:
 - Sprinkler selection criteria for residential, light hazard, ordinary hazard, extra hazard, special designs and storage applications
 - Minimum design pressure
 - Minimum or maximum clearances from the sprinkler to the hazard
 - Installation requirements based on the selected sprinkler
 - The SIN (Sprinkler Identification Number)



Manufacturer Data Sheet

VIKING®

TECHNICAL DATA

MICROMATIC® STANDARD
RESPONSE UPRIGHT
SPRINKLER VK100 (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

1. DESCRIPTION

The Viking Micromatic® Standard Response Upright VK100 Sprinkler is a small, thermostatic, glass-bulb spray sprinkler available in several different finishes and temperature ratings to meet design requirements. The special Polyester and Electroless Nickel PTFE (ENT) coatings can be used in decorative applications where colors are desired. In addition, these coatings have been investigated for installation in corrosive atmospheres and are listed/approved as corrosion resistant as indicated in the Approval Charts. (Note: FM Global approves the ENT coating as corrosion resistant. FM Global has no approval classification for Polyester coatings as corrosion resistant.)
Viking standard response sprinklers may be ordered and/or used as open sprinklers (glass bulb and pip cap assembly removed) on deluge systems. Refer to Ordering Instructions.



2. LISTINGS AND APPROVALS

cULus Listed: Category VNIIV
 FM Approved: Classes 2001, 2002, 2015, 2017, 2043

NOTE: Other International approval certificates are available upon request.
Refer to Approval Chart 1 and UL Design Criteria on pages cULus Listing requirements, and refer to Approval Chart 2 and FM Design Criteria for FM Approval requirements that must be followed.

2015 IFC and IBC Fire Protection Systems

76

Manufacturer Data Sheet



TECHNICAL DATA

MICROMATIC® STANDARD RESPONSE UPRIGHT SPRINKLER VK100 (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
 Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

1. DESCRIPTION

The Viking Micromatic® Standard Response Upright VK100 Sprinkler is a small, thermosensitive, glass-bulb spray sprinkler available in several different finishes and temperature ratings to meet design requirements. The special Polyester and Electroless Nickel PTFE (ENT) coatings can be used in decorative applications where colors are desired. In addition, these coatings have been investigated for installation in corrosive atmospheres and are listed/approved as corrosion resistant as indicated in the Approval Charts. (Note: FM Global approves the ENT coating as corrosion resistant. FM Global has no approval classification for Polyester coatings as corrosion resistant.) Viking standard response sprinklers may be ordered and/or used as open sprinklers (glass bulb and pip cap assembly removed) on deluge systems. Refer to Ordering Instructions.



2. LISTINGS AND APPROVALS

cULus Listed: Category VNIIV
FM Approved: Classes 2001, 2002, 2015, 2017, 2043

NOTE: Other International approval certificates are available upon request. Refer to Approval Chart 1 and UL Design Criteria on pages cULus Listing requirements, and refer to Approval Chart 2 and FM Design Criteria for FM Approval requirements that must be followed.



2015 IFC and IBC Fire Protection Systems

77

Manufacturer Data Sheet

3. TECHNICAL DATA

Specifications:
 Minimum Operating Pressure: 7 psi (0.5 bar)
 Maximum Working Pressure: 175 psi (12 bar) wwp
 Factory tested hydrostatically to 500 psi (34.5 bar)
 Thread size: 1/2" NPT, 15 mm BSP
 Nominal K-Factor: 5.6 U.S. (80.6 metric**)
 Glass-bulb fluid temperature rated to -65 °F (-55 °C)
 Overall Length: 2-3/8" (60 mm)

† cULus Listing, FM Approval, and NFPA 13 installs require a minimum of 7 psi (0.5 bar). The minimum operating pressure for LPCB and CE Approvals ONLY is 5 psi (0.35 bar).

** Metric K-factor measurement shown is in Bar. When pressure is measured in kPa, divide the metric K-factor shown by 10.0.

Material Standards:
 Frame Casting: Brass UNS-C84400 or QM Brass
 Deflector: Brass UNS-C23000 or Copper UNS-C19500
 Bulb: Glass, nominal 5 mm diameter
 Belleville Spring Sealing Assembly: Nickel Alloy, coated on both sides with PTFE Tape
 Screw: Brass UNS-C36000
 Pip Cap and Insert Assembly: Copper UNS-C11000 and Stainless Steel UNS-S30400

For Polyester Coated Sprinklers: Belleville Spring-Exposed
 For ENT coated Sprinklers: Belleville Spring - Exposed, Screw and Pipcap - ENT plated.

†† Not for FM Approval.
 Ordering Information: (Also refer to the current Viking price list.)
 Order Micromatic® Standard Response Upright VK100 by first adding the appropriate suffix for the sprinkler finish and then the appropriate suffix for the temperature rating to the sprinkler base part number.
 Finish Suffix: Brass = A, Chrome = F, White Polyester = M-W, Black Polyester = M-B, Wax Coated = C, Wax Over Polyester = V-W, ENT = JN
 Temperature Suffix: 135 °F (57 °C) = A, 155 °F (68 °C) = B, 175 °F (79 °C) = D, 200 °F (93 °C) = E, 212 °F (100 °C) = M, 286 °F (141 °C) = G, 360 °F (182 °C) = H, 500 °F (260 °C) = L, OPEN = Z (PTFE only).
 For example, sprinkler VK100 with a 1/2" thread, Brass finish and a 155 °F (68 °C) temperature rating = Part No. 12986AB

Viking Technical Data may be found on The Viking Corporation's Web site at <http://www.vikinggroupinc.com>. The Web site may include a more recent edition of this Technical Data Page.



2015 IFC and IBC Fire Protection Systems

78

Manufacturer Data Sheet

3. TECHNICAL DATA

Specifications:
 Minimum Operating Pressure: 7 psi (0.5 bar)
 Maximum Working Pressure: 175 psi (12 bar) wwp
 Factory tested hydrostatically to 500 psi (34.5 bar)
 Thread size: 1/2" NPT, 15 mm BSP
 Nominal K-Factor: 5.6 U.S. (80.6 metric**)
 Glass-bulb fluid temperature rated to -65 °F (-55 °C)
 Overall Length: 2-3/8" (60 mm)

† cULus Listing, FM Approval, and NFPA 13 installs require a minimum of 7 psi (0.5 bar). The minimum operating pressure for LPCB and CE Approvals ONLY is 5 psi (0.35 bar).

** Metric K-factor measurement shown is in Bar. When pressure is measured in kPa, divide the metric K-factor shown by 10.0.

Material Standards:
 Frame Casting: Brass UNS-C84400 or QM Brass
 Deflector: Brass UNS-C23000 or Copper UNS-C19500
 Bulb: Glass, nominal 5 mm diameter
 Belleville Spring Sealing Assembly: Nickel Alloy, coated on both sides with PTFE Tape
 Screw: Brass UNS-C36000
 Pip Cap and Insert Assembly: Copper UNS-C11000 and Stainless Steel UNS-S30400

For Polyester Coated Sprinklers: Belleville Spring-Exposed
 For ENT coated Sprinklers: Belleville Spring - Exposed, Screw and Pipcap - ENT plated.

†† Not for FM Approval.
 Ordering Information: (Also refer to the current Viking price list.)
 Order Micromatic® Standard Response Upright VK100 by first adding the appropriate suffix for the sprinkler finish and then the appropriate suffix for the temperature rating to the sprinkler base part number.
 Finish Suffix: Brass = A, Chrome = F, White Polyester = M-W, Black Polyester = M-B, Wax Coated = C, Wax Over Polyester = V-W, ENT = JN
 Temperature Suffix: 135 °F (57 °C) = A, 155 °F (68 °C) = B, 175 °F (79 °C) = D, 200 °F (93 °C) = E, 212 °F (100 °C) = M, 286 °F (141 °C) = G, 360 °F (182 °C) = H, 500 °F (260 °C) = L, OPEN = Z (PTFE only).
 For example, sprinkler VK100 with a 1/2" thread, Brass finish and a 155 °F (68 °C) temperature rating = Part No. 12986AB

Viking Technical Data may be found on The Viking Corporation's Web site at <http://www.vikinggroupinc.com>. The Web site may include a more recent edition of this Technical Data Page.



2015 IFC and IBC Fire Protection Systems

79

Manufacturer Data Sheet



TECHNICAL DATA

MICROMATIC® STANDARD RESPONSE UPRIGHT SPRINKLER VK100 (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
 Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Sprinkler Temperature Classification	Sprinkler Nominal Temperature Rating†	Maximum Ambient Ceiling Temperature‡	Bulb Color
Ordinary	135 °F (57 °C)	100 °F (38 °C)	Orange
Ordinary	155 °F (68 °C)	100 °F (38 °C)	Red
Intermediate	175 °F (79 °C)	150 °F (65 °C)	Yellow
Intermediate	200 °F (93 °C)	150 °F (65 °C)	Green
High	286 °F (141 °C)	225 °F (107 °C)	Blue
Extra High	360 °F (182 °C)	300 °F (149 °C)	Mauve
Ultra High†	500 °F (260 °C)	465 °F (240 °C)	Black

Sprinkler Finishes: Brass, Chrome, White Polyester, Black Polyester, and ENT
Corrosion Resistant Coatings: White Polyester, Black Polyester, and Black PTFE in all temperature ratings. ENT in all temperature ratings except 135 °F (57 °C). Wax-Coated Brass and Wax over Polyester* for sprinklers with the following temperature ratings: 155 °F (68 °C) Lt. Brown Wax 175 °F (79 °C) Brown Wax 200 °F (93 °C) Brown Wax 286 °F (141 °C) Dk. Brown Wax*



2015 IFC and IBC Fire Protection Systems

80

Manufacturer Data Sheet



TECHNICAL DATA

MICROMATIC® STANDARD RESPONSE UPRIGHT SPRINKLER VK100 (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Approval Chart 1 (UL)
Micromatic® Standard Response Upright Sprinkler VK100
Maximum 175 PSI (12 bar) WWP

Sprinkler Base Part Number ¹	SIN	Thread Size		Nominal K-Factor		Overall Length		Listings and Approvals ² (Refer also to UL Design Criteria)			
		NPT	BSP	U.S.	metric ³	Inches	mm	cULus ⁴	VdS	LPCB	CE
Standard Orifice											
12986	VK100	1/2"	15 mm	5.6	80.8	2-1/4"	57	A1, B3, C4, D2, E5	—	—	—
12993	VK100	—	20 mm	5.6	80.8	2-1/4"	57	A1, B3, C4, D2, E5	—	—	—
NOTICE - Product Below - Limited Availability (Contact Local Viking Office)											
10138	VK100	1/2"	15 mm	5.6	80.8	2-1/4"	57	A1, B3, C4, D2, E5	—	—	—
10193	VK100	—	20 mm	5.6	80.8	2-1/4"	57	A1, B3, C4, D2, E5	—	—	—



2015 IFC and IBC Fire Protection Systems

81

Manufacturer Data Sheet



TECHNICAL DATA

MICROMATIC® STANDARD RESPONSE UPRIGHT SPRINKLER VK100 (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Approval Chart 1 (UL)
Micromatic® Standard Response Upright Sprinkler VK100
Maximum 175 PSI (12 bar) WWP

Sprinkler Base Part Number ¹	SIN	Thread Size		Nominal K-Factor		Overall Length		Listings and Approvals ² (Refer also to UL Design Criteria)			
		NPT	BSP	U.S.	metric ³	Inches	mm	cULus ⁴	VdS	LPCB	CE
Standard Orifice											
12986	VK100	1/2"	15 mm	5.6	80.8	2-1/4"	57	A1, B3, C4, D2, E5	—	—	—
12993	VK100	—	20 mm	5.6	80.8	2-1/4"	57	A1, B3, C4, D2, E5	—	—	—
NOTICE - Product Below - Limited Availability (Contact Local Viking Office)											
10138	VK100	1/2"	15 mm	5.6	80.8	2-1/4"	57	A1, B3, C4, D2, E5	—	—	—
10193	VK100	—	20 mm	5.6	80.8	2-1/4"	57	A1, B3, C4, D2, E5	—	—	—

DESIGN CRITERIA - UL
(Also refer to Approval Chart 1.)

cULus Listing Requirements:
The Viking Micromatic® Standard Response Upright Sprinkler VK100 is cULus Listed as indicated in Approval Chart 1 for installation in accordance with the latest edition of NFPA 13 for standard spray sprinklers.

- Designed for use in Light, Ordinary, and Extra Hazard occupancies.
- The sprinkler installation rules contained in NFPA 13 for standard spray upright sprinklers must be followed.

IMPORTANT: Always refer to Bulletin Form No. F-091699 - Care and Handling of Sprinklers. Also refer to page SR1-3 for general care, installation, and maintenance information. Viking sprinklers are to be installed in accordance with the latest edition of Viking technical data, the appropriate standards of NFPA, LPCB, APSAD, VdS or other similar organizations, and also with the provisions of governmental codes, ordinances, and standards, whenever applicable.



2015 IFC and IBC Fire Protection Systems

82

Manufacturer Data Sheet



TECHNICAL DATA

MICROMATIC® STANDARD RESPONSE UPRIGHT SPRINKLER VK100 (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Approval Chart 2 (FM)
Micromatic® Standard Response Upright Sprinkler VK100
Maximum 175 PSI (12 bar) WWP

Sprinkler Base Part Number ¹	SIN	Thread Size		Nominal K-Factor		Overall Length		FM Approvals ² (Refer also to Design Criteria below.)			
		NPT	BSP	U.S.	metric ³	Inches	mm	A1, D1, E4, F8, G5	A1, B2, C3, D1, E4, F8	A1, B2, C3, D1, E4, F8	A1, G5, D1, E4, F8
Standard Orifice											
12986	VK100	1/2"	15 mm	5.6	80.8	2-1/4"	57	A1, D1, E4, F8, G5	A1, B2, C3, D1, E4, F8	A1, B2, C3, D1, E4, F8	A1, G5, D1, E4, F8
12993	VK100	—	20 mm	5.6	80.8	2-1/4"	57	A1, D1, E4, F8, G5	A1, B2, C3, D1, E4, F8	A1, B2, C3, D1, E4, F8	A1, G5, D1, E4, F8
NOTICE - Product Below - Limited Availability (Contact Local Viking Office)											
10138	VK100	1/2"	15 mm	5.6	80.8	2-1/4"	57	A1, D1, E4, F8, G5	A1, B2, C3, D1, E4, F8	A1, B2, C3, D1, E4, F8	A1, G5, D1, E4, F8
10193	VK100	—	20 mm	5.6	80.8	2-1/4"	57	A1, D1, E4, F8, G5	A1, B2, C3, D1, E4, F8	A1, B2, C3, D1, E4, F8	A1, G5, D1, E4, F8

DESIGN CRITERIA - FM
(Also refer to Approval Chart 2.)

FM Approval Requirements:
The Viking Micromatic® Standard Response Upright Sprinkler VK100 is FM Approved as standard response **Non-Storage upright sprinkler** as indicated in the FM Approval Guide. For specific application and installation requirements, reference the latest **Approvals, FM Loss Prevention Data Sheets (including Data Sheet 2-0)**. FM Global Loss Prevention Data Sheets contain guidelines relating to, but not limited to: minimum water supply requirements, hydraulic design, ceiling slope and obstructions, minimum and maximum allowable spacing, and deflector distance below the ceiling.

NOTE: The FM installation guidelines may differ from cULus and/or NFPA criteria.

IMPORTANT: Always refer to Bulletin Form No. F-091699 - Care and Handling of Sprinklers. Also refer to page SR1-3 for general care, installation, and maintenance information. Viking sprinklers are to be installed in accordance with the latest edition of Viking technical data, the appropriate standards of NFPA, FM Global, LPCB, APSAD, VdS or other similar organizations, and also with the provisions of governmental codes, ordinances, and standards, whenever applicable.



2015 IFC and IBC Fire Protection Systems

83

Manufacturer Data Sheet



TECHNICAL DATA

MICROMATIC® STANDARD RESPONSE UPRIGHT SPRINKLER VK100 (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Approval Chart 2 (FM)
Micromatic® Standard Response Upright Sprinkler VK100
Maximum 175 PSI (12 bar) WWP

Sprinkler Base Part Number ¹	SIN	Thread Size		Nominal K-Factor		Overall Length		FM Approvals ² (Refer also to Design Criteria below.)			
		NPT	BSP	U.S.	metric ³	Inches	mm	A1, D1, E4, F8, G5	A1, B2, C3, D1, E4, F8	A1, B2, C3, D1, E4, F8	A1, G5, D1, E4, F8
Standard Orifice											
12986	VK100	1/2"	15 mm	5.6	80.8	2-1/4"	57	A1, D1, E4, F8, G5	A1, B2, C3, D1, E4, F8	A1, B2, C3, D1, E4, F8	A1, G5, D1, E4, F8
12993	VK100	—	20 mm	5.6	80.8	2-1/4"	57	A1, D1, E4, F8, G5	A1, B2, C3, D1, E4, F8	A1, B2, C3, D1, E4, F8	A1, G5, D1, E4, F8
NOTICE - Product Below - Limited Availability (Contact Local Viking Office)											
10138	VK100	1/2"	15 mm	5.6	80.8	2-1/4"	57	A1, D1, E4, F8, G5	A1, B2, C3, D1, E4, F8	A1, B2, C3, D1, E4, F8	A1, G5, D1, E4, F8
10193	VK100	—	20 mm	5.6	80.8	2-1/4"	57	A1, D1, E4, F8, G5	A1, B2, C3, D1, E4, F8	A1, B2, C3, D1, E4, F8	A1, G5, D1, E4, F8

DESIGN CRITERIA - FM
(Also refer to Approval Chart 2.)

FM Approval Requirements:
The Viking Micromatic® Standard Response Upright Sprinkler VK100 is FM Approved as standard response **Non-Storage upright sprinkler** as indicated in the FM Approval Guide. For specific application and installation requirements, reference the latest **Approvals, FM Loss Prevention Data Sheets (including Data Sheet 2-0)**. FM Global Loss Prevention Data Sheets contain guidelines relating to, but not limited to: minimum water supply requirements, hydraulic design, ceiling slope and obstructions, minimum and maximum allowable spacing, and deflector distance below the ceiling.

NOTE: The FM installation guidelines may differ from cULus and/or NFPA criteria.

IMPORTANT: Always refer to Bulletin Form No. F-091699 - Care and Handling of Sprinklers. Also refer to page SR1-3 for general care, installation, and maintenance information. Viking sprinklers are to be installed in accordance with the latest edition of Viking technical data, the appropriate standards of NFPA, FM Global, LPCB, APSAD, VdS or other similar organizations, and also with the provisions of governmental codes, ordinances, and standards, whenever applicable.



2015 IFC and IBC Fire Protection Systems

84

ACTIVITY

Automatic Sprinkler Systems

1. Does IBC/IFC §1020.4 allow an increase the length of a dead-end corridor in a Group R-1 occupancy when an NFPA 13R automatic fire sprinkler system is installed?
2. What prescriptive method of design is permitted for the design of an automatic sprinkler system?

2015 IFC and IBC Fire Protection Systems 85

ACTIVITY

Automatic Sprinkler Systems

3. What is RTI and what range of RTI is required for a sprinkler to be either fast response, quick response or residential?
4. What type of fire sprinkler system is designed for all sprinklers to flow simultaneously?

2015 IFC and IBC Fire Protection Systems 85

Module 3

Sprinkler System Requirements



2015 IFC and IBC Fire Protection Systems

Required Fire Sprinklers

- Fire sprinklers requirements are based on:
 - Occupancy classification **Group H-5**
 - Size of fire area containing a specific occupancy **Group F-1 fire area >12,000 ft²**
 - Occupant load in a specific occupancy **Group A-2 with OL ≥100**
 - Floor level of the specific occupancy **Group A-3 on a level other than the LED**
 - Specific operation occurring in the building **High-piled storage**
 - Modification of other code requirements **Height/Area Travel distance Haz Mat quantities**

2015 IFC and IBC Fire Protection Systems 88

Fire Sprinkler System Installation

- The area to be protected by sprinklers is dependent on the occupancy classification

Occupancy Classification	Fire Area	Occupancy	Entire Floor ¹	Entire Building
A-1, A-2, A-3, A-4	X		X	
A-5		2		
B Ambulatory Care Facilities			X	
E	X		X ³	
F-1	X ⁴			X
H-1, H-2, H-3, H-4		X		X ⁵
H-5				X
I				X
M	X			X
R				X
S	X			X

Fire Sprinkler System Installation

- The area to be protected by sprinklers is dependent on the occupancy classification

Occupancy Classification	Fire Area	Occupancy	Entire Floor ¹	Entire Building
A-1, A-2, A-3, A-4	X		X	
A-5		2		
B Ambulatory Care Facilities			X	
E	X		X ³	
F-1	X ⁴			X
H-1, H-2, H-3, H-4		X		X ⁵
H-5				X
I				X
M	X			X
R				X
S	X			X

¹ The fire sprinkler system is installed on the floor level of the occupancy and every floor level between that floor and the LED, including the LED

Fire Sprinkler System Installation

- The area to be protected by sprinklers is dependent on the occupancy classification

Occupancy Classification	Fire Area	Occupancy	Entire Floor ¹	Entire Building
A-1, A-2, A-3, A-4	X		X	
A-5		2		
B Ambulatory Care Facilities			X	
E	X		X ³	
F-1	X ⁴			X
H-1, H-2, H-3, H-4		X		X ⁵
H-5				X
I				X
M	X			X
R				X
S	X			X

Fire Sprinkler System Installation

- The area to be protected by sprinklers is dependent on the occupancy classification

Occupancy Classification	Fire Area	Occupancy	Entire Floor ¹	Entire Building
A-1, A-2, A-3, A-4	X		X	
A-5		2		
B Ambulatory Care Facilities			X	
E	X		X ³	
F-1	X ⁴			X
H-1, H-2, H-3, H-4		X		X ⁵
H-5				X
I				X
M	X			X
R				X
S	X			X

² Fire sprinklers are required in concession stands, retail areas, press boxes and other accessory use areas >1,000 ft²

Fire Sprinkler System Installation

- The area to be protected by sprinklers is dependent on the occupancy classification

Occupancy Classification	Fire Area	Occupancy	Entire Floor ¹	Entire Building
A-1, A-2, A-3, A-4	X		X	
A-5		2		
B Ambulatory Care Facilities			X	
E	X		X ³	
F-1				X
H-1, H-2, H-3, H-4		X		X ⁵
H-5				X
I				X
M	X			X
R				X
S	X			X

³ Fire sprinklers required in all floors below the LED



Fire Sprinkler System Installation

- The area to be protected by sprinklers is dependent on the occupancy classification

Occupancy Classification	Fire Area	Occupancy	Entire Floor ¹	Entire Building
A-1, A-2, A-3, A-4	X		X	
A-5		2		
B Ambulatory Care Facilities			X	
E	X		X ³	
F-1	X ⁴			X
H-1, H-2, H-3, H-4		X		X ⁵
H-5				X
I				X
M				X
R				X
S	X			X

⁴ Fire sprinklers required in fire areas where woodworking occurs with an area of 2,501-12,000 ft²



Fire Sprinkler System Installation

- The area to be protected by sprinklers is dependent on the occupancy classification

Occupancy Classification	Fire Area	Occupancy	Entire Floor ¹	Entire Building
A-1, A-2, A-3, A-4	X		X	
A-5		2		
B Ambulatory Care Facilities			X	
E	X		X ³	
F-1	X ⁴			X
H-1, H-2, H-3, H-4		X		X ⁵
H-5				X
I				X
M				X
R				X
S	X			X

⁵ Group H occupancies with >100 lbs of pyroxylin plastics



Fire Sprinkler System Installation

- The area to be protected by sprinklers is dependent on the occupancy classification

Occupancy Classification	Fire Area	Occupancy	Entire Floor ¹	Entire Building
A-1, A-2, A-3, A-4	X		X	
A-5		2		
B Ambulatory Care Facilities			X	
E	X		X ³	
F-1	X ⁴			X
H-1, H-2, H-3, H-4		X		X ⁵
H-5				X
I				X
M	X			X
R				X
S	X			X



Fire Sprinkler System Installation

- The area to be protected by sprinklers is dependent on the occupancy classification

Occupancy Classification	Fire Area	Occupancy	Entire Floor ¹	Entire Building
A-1, A-2, A-3, A-4	X		X	
A-5		2		
B Ambulatory Care Facilities			X	
F				X
H-1, H-2				X ⁵
H-3				X
I				X
M	X			X
R				X
S	X			X

Bottom line – read the code requirements carefully




97

Fire Sprinklers in Group A §903.2.1

- Where fire sprinklers are required in a Group A occupancy located on a story other than LED, fire sprinklers must be installed on all stories leading to all levels of exit discharge that are used by the Group A occupancy

Automatic sprinkler system installed on story with Group A

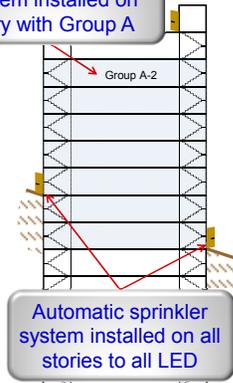

98

Group A-1 §903.2.1.1

- Fire sprinklers required where one of the following conditions exists:
 - Fire area >12,000 ft²
 - Fire area has an OL ≥300
 - Fire area is located on a level other than LED
 - Fire area contains a multitheater complex



99

Group A-2 §903.2.1.2

- Fire sprinklers required where one of the following conditions exists:
 - Fire area >5,000 ft²
 - Fire area has an OL ≥100
 - Fire area is located on a level other than LED



100


Group A-3 & A-4 §903.2.1.3, §903.2.1.4

- Fire sprinklers required where one of the following conditions exist:
 - Fire area >12,000 ft²
 - Fire area has OL ≥300
 - Fire area is located on a level other than LED




Group A-5 §903.2.1.5

- Fire sprinklers required in the following areas in excess of 1,000 ft² that are accessory to stadiums or arenas:
 - Concession areas
 - Retail areas
 - Press boxes

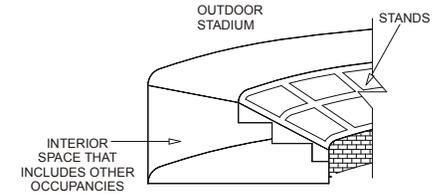

Assembly Occupancies on Roofs §903.2.1.6

- Fire sprinklers are required on all floors between an occupied roof and the LED discharge where assembly uses occur on the rooftop and:
 - OL >100 for Group A-2, or
 - OL >300 for other Group A occupancies




Multiple Group A Fire Areas §903.2.1.7

- Sprinklers required where multiple fire areas contain Group A-1, A-2, A-3 or A-4 occupancies that share egress components and OL ≥300


All occupancies separated by 2-HR fire barriers

All fire areas considered separately
Sprinklers not required

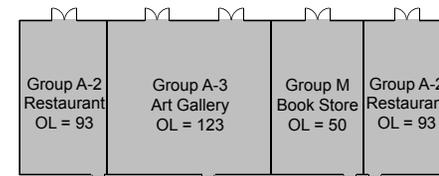

Multiple Group A Fire Areas §903.2.1.7

- Sprinklers required where multiple fire areas contain Group A-1, A-2, A-3 or A-4 occupancies that share egress components and OL ≥ 300

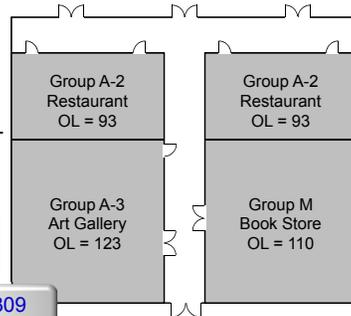

All occupancies separated by 2-HR fire barriers

Aggregate occupant load = 309
Therefore, sprinklers are required



Ambulatory Care Facilities §903.2.2



How do you determine the number of care recipients?

Count the beds

- Fire sprinklers required on floors with a Group B Ambulatory Care Facility when:
 - ≥ 4 care recipients incapable of self-preservation
 - ≥ 1 care recipients incapable of self-preservation on a floor other than LED

§903.3.2 requires the installation of QR or residential sprinklers throughout smoke compartments containing treatment rooms



Group E §903.2.3

- Fire sprinklers required in the occupancy when one of the following conditions exist:
 - Fire area $> 12,000$ ft²
 - All portions below LED
 - Sprinklers **not** required in areas below LED where each classroom has at least one exterior exit door at ground level



Group F-1 §903.2.4

- Fire sprinklers required throughout the building where one of the following conditions exist:
 - Fire area $> 12,000$ ft²
 - Fire area is > 3 stories above grade
 - Aggregate fire areas $> 24,000$ ft²
 - Used for manufacture of upholstered furniture or mattresses $> 2,500$ ft²



Woodworking Operations §903.2.4.1

- Fire sprinklers required throughout the building where **both** of the following conditions exist:
 - Fire area >2,500 ft²
 - The process generates finely divided waste or uses finely divided combustible materials



2015 IFC and IBC Fire Protection Systems

109

Group H §903.2.5

- Fire sprinklers required in all Group H occupancies
- §5004.5 requires systems to meet Ordinary Hazard Group 2 criteria, at minimum with 3,000 ft² design area
 - 0.17 gpm/ft²
 - Many materials require more water



- Flammable & combustible liquids
- Flammable & pyrophoric gases
- Level 2 & 3 aerosols
- Organic peroxides
- Oxidizers



2015 IFC and IBC Fire Protection Systems

110

Group H-5 §903.2.5.2

- Fire sprinklers required throughout the building
- IFC Table 903.2.5.2 establishes minimum design criteria for automatic sprinklers based on the location in the building



2015 IFC and IBC Fire Protection Systems

111

Group I §903.2.6

- Fire sprinklers required throughout the building
- §903.2.6 allows the installation of NFPA 13R systems in Group I-1 Condition 1
- §903.3.2 requires the installation of QR or residential sprinklers in:
 - All areas of smoke compartments containing care recipient sleeping units in Group I-2
 - Sleeping units in Group I-1



2015 IFC and IBC Fire Protection Systems

112

Group M §903.2.7

- Fire sprinklers required throughout the building where one of the following conditions exist:
 - Fire area >12,000 ft²
 - Fire area >3 stories above grade
 - Aggregate fire areas >24,000 ft²
 - Used for display and sale of upholstered furniture or mattresses >5,000 ft²



2015 IFC and IBC Fire Protection Systems

113

Group R §903.2.8

- Fire sprinklers required throughout the building for all Group I occupancies
- NFPA 13D systems in Group R-3, R-4 Condition 1 and care facilities with ≤5 clients
- NFPA 13R systems in Group R-4 Condition 2
- §903.3.2 requires the installation of QR or residential sprinklers in dwelling units and sleeping units



2015 IFC and IBC Fire Protection Systems

114

Group R §903.2.8

- Fire sprinklers required throughout the building for all Group I occupancies
- NFPA 13D systems in Group R-3, R-4 Condition 1 and care facilities with ≤5 clients
- NFPA 13R systems in Group R-4 Condition 2
- §903.3.2 requires the installation of QR or residential sprinklers in dwelling units and sleeping units

1- & 2-family dwellings and townhomes built under the IRC are sprinklered in accordance with the IRC or NFPA 13D



2015 IFC and IBC Fire Protection Systems

115

Pedestal/Podium Construction IBC §510

- Group R occupancies with parking beneath
- Depending on the construction and the building's height and area, the design of the sprinkler system may be based on NFPA 13, 13R or a combination of NFPA 13 and 13R



2015 IFC and IBC Fire Protection Systems

116

Pedestal/Podium Construction

3-HR horizontal assembly

Any occupancy other than Group H

Type IA construction

Number of stories for Group R

Building height

NFPA 13R for Group R *IF* ≤ 4 stories **AND** height is $\leq 60'$

2015 IFC and IBC Fire Protection Systems 117

Pedestal/Podium Construction

NFPA 13 for Group R *IF* > 4 stories **OR** height is $> 60'$

2015 IFC and IBC Fire Protection Systems 118

Group S-1 §903.2.9

- Fire sprinklers required throughout the building where one of the following conditions exist:
 - Fire area $> 12,000$ ft²
 - Fire area is > 3 stories above grade
 - Aggregate fire areas $> 24,000$ ft²
 - Used for storage of upholstered furniture or mattresses $> 2,500$ ft²
 - The storage of commercial trucks or buses when the fire area is $> 5,000$ ft²

2015 IFC and IBC Fire Protection Systems 119

Group S-1 Repair Garages §903.2.9.1

- Fire sprinklers required throughout the building when one of the following conditions exist:
 - Building is 1 story **and** fire area $> 12,000$ ft²
 - Building is ≥ 2 stories **and** fire area $> 10,000$ ft²
 - Repair garage is located in a basement
 - Repair garage for commercial trucks or buses and the fire area is $> 5,000$ ft²

2015 IFC and IBC Fire Protection Systems 120

Group S-1 Storage of Tires §903.2.9.2

- Fire sprinklers required when:
 - Fire area >20,000 cubic feet



Would this be considered high-piled combustible storage?

Group S-2 Enclosed Parking Garage §903.2.10

- Fire sprinklers required when :
 - Fire area >12,000 ft²
 - Parking garage is located beneath another occupancy



Basements and Stories without Openings §903.2.11.1

- Fire sprinklers required on every story, including basements, where floor area >1,500 ft²

UNLESS:


- Openings are provided on at least wall with 1 opening within each 50' of wall, and
- Openings are separated ≤50'
- Travel distance to exterior openings ≤75'
- Each opening is ≥20 ft²

- Frequently applied to basements
- Also applies to above grade stories



Basements and Stories without Openings §903.2.11.1

Each opening ≥20 ft²

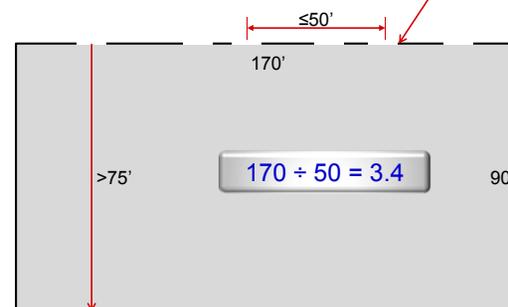

Buildings ≥55' in Height §903.2.11.3

- Fire sprinklers required in buildings having a story ≥55' above the LLFDVA with OL ≥30



Other Hazards §903.2.11.4

- Fire sprinkler required in hazardous exhaust ducts with a diameter ≥10"
- If used for conveying a corrosive atmosphere, sprinklers must be listed for the atmosphere
- Listed flexible hose sprinklers are special sprinklers with pressure & flow calculated in accordance with NFPA 13, §11.2.3.4.3




Photograph courtesy of Flexhead Inc.



Balconies and Decks §903.3.1.2.1


- Addition to NFPA 13R
- Fire sprinklers required on balconies, decks and patios in Type V construction with a roof or deck above
- The sprinklers must be installed 1" – 6" below a structural member and ≤14" below the deck above

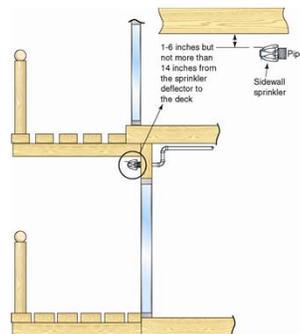

Limited Area Sprinkler Systems §903.3.8

- ≤6 sprinklers/fire area
- Light Hazard or Ord Haz Group 1
- Water supply from standpipe, if provided, or domestic water piping
- Calculated per NFPA 13

Limited Area Sprinkler System

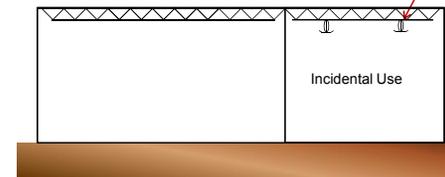

Sprinkler System Supervision §903.4

- Water-flow switches, pressure switches and valves that control the water supply for a fire sprinkler system must be electrically supervised
- 7 exceptions



Sprinkler System Supervision §903.4

- Water-flow switches, pressure switches and valves that control the water supply for a fire sprinkler system must be electrically supervised
- 7 exceptions

1. 1- & 2-family dwellings
2. Limited area sprinkler systems
3. NFPA 13R sprinkler systems with a common supply for both domestic and sprinkler water with no shutoff
4. Jockey pump control valves
5. Control valves sealed or locked in the open position
6. Valves controlling the fuel supply
7. Trim valves sealed or locked in the open position



Sprinkler System Alarm Signals §903.4.1

- Alarm signals must be sent to:
 - Supervising station, or
 - Constantly attended location

What does "constantly attended" mean?



Photo courtesy of Property Protection Inc.



Sprinkler Systems §903.4

- An approved audible device shall be provided for each sprinkler system and located on the exterior of the building



Sprinkler Systems §903.4

- An approved audible device shall be provided for each sprinkler system and located on the exterior of the building
- Floor control valves are on each riser on each floor in high-rise buildings



Fire Department Connection §912

- Street side of building




Fire Department Connection §912

- Street side of building
- 3' access around FDC



Fire Department Connection §912

- Street side of building
- 3' access around FDC
- Location approved by FCO

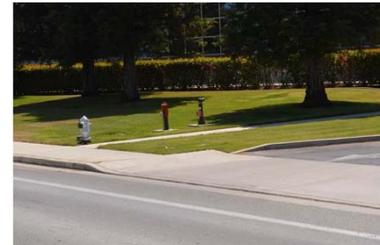

Fire Department Connection §912

- Street side of building
- 3' access around FDC
- Location approved by FCO
- Approved fittings



Fire Department Connection §912

- Street side of building
- 3' access around FDC
- Location approved by FCO
- Approved fittings
- Labeled



Fire Department Connection §912

- Street side of building
- 3' access around FDC
- Location approved by FCO
- Approved fittings
- Labeled
- Visible from street
OR signs directing to FDC



Automatic Sprinkler Requirements

1. How many patients must be rendered incapable of self-preservation before an automatic sprinkler system is required in an ambulatory care facility located on the grade plane of a building?



ACTIVITY

Automatic Sprinkler Requirements

2. Which of the following occupancy groups does not require automatic sprinkler protection throughout a building regardless of size?

- A. Group S-1
- B. Group R-2
- C. Group H-5
- D. Group I-2

2015 IFC and IBC Fire Protection Systems 141

ACTIVITY

Automatic Sprinkler Requirements

3. T F When sprinklers are required to be installed throughout the entire building, this means that the system must be designed to NFPA 13.

4. What is the minimum sprinkler discharge density and design area for a Group H-4 occupancy?

2015 IFC and IBC Fire Protection Systems 142

Module 4

Automatic Fire-Extinguishing Systems



2015 IFC and IBC Fire Protection Systems 144

Fire-extinguishing Systems §904

- The following suppression types of fire-extinguishing systems are recognized:
 - Dry chemical
 - Wet chemical
 - Carbon Dioxide (CO₂)
 - Halon
 - Clean agent
 - Aqueous film forming foam
 - Water mist

2015 IFC and IBC Fire Protection Systems 144

Flammable Liquid Containment Dike AFFF Flooding System



Photo courtesy of International Code Consultants, Inc.



Design and Acceptance Testing Considerations for AFES

- Is the selected agent compatible with the hazard being protected?
- Is the system pre-engineered or an engineered design?
- Is the system a local application or total flooding design?
- If applicable, what is the integrity of the enclosure as it relates to air movement and infiltration?
- Is the amount of agent adequate to protect the largest hazard?



CO2 Automatic Fire-extinguishing System



Application nozzles

45,000 gallon dip tank of mineral spirits



Fire-extinguishing Systems §904.2

2015 IFC
§904.2
§904.2.1
Page 112

904.2 Where permitted. Automatic fire-extinguishing systems installed as an alternative to the required automatic sprinkler systems of Section 903 shall be approved by the fire code official.

904.2.1 Restriction on using automatic sprinkler system exceptions or reductions. Automatic fire-extinguishing systems shall not be considered alternatives for the purposes of exceptions or reductions allowed for automatic sprinkler systems or by other requirements of this code.



Installation Requirements for Automatic Fire-extinguishing Systems

- Systems must be designed to automatically activate
- For agents which pose a health hazard, alarm signals shall warn occupants when the system is in the process of beginning to discharge
- For buildings also equipped with a fire alarm system, the AFES must be monitored by the fire alarm system
- Where the AFES system requires notification devices, they must be audible and visual



Inspection and Testing of Automatic Fire-extinguishing Systems

- Prior to an acceptance test, the following elements to be inspected:
 - Confirm the design is consistent with the hazard being protected
 - Placement and location of detection devices, discharge nozzles, alarms and manual means of activation
 - Signs and operating instructions for the system



Dry-chemical Fire-extinguishing Systems

- Dry-chemical AFES can be engineered or pre-engineered fire suppression systems designed to protect a specific hazard or can be used for total flooding protection applications



Photograph courtesy of Tyco/Ansul Inc., Marinette, WI



Dry-chemical Fire-extinguishing Systems

- Dry-chemical AFES can be engineered or pre-engineered fire suppression systems designed to protect a specific hazard or can be used for total flooding protection applications



- Flammable and combustible liquids
- Flammable gases
- Combustible solids, such as plastics and ordinary combustibles

- 6-month inspection and testing of:
 - Detection and releasing devices
 - Alarms (where required)
 - Verification that a sufficient volume of agent is available for the protected hazard



Carbon Dioxide (CO₂) Fire-extinguishing Systems

- CO₂ systems can be designed for local application, total flooding or hand hoselines using NFPA 12
- Systems can be engineered or pre-engineered
- Inspected and tested every 6 months
- High-pressure cylinders must be weighed every 6 months to ensure a sufficient amount of agent is available
- Hoses and auxiliary equipment must be inspected annually




Halon Fire-extinguishing Systems

- Manufacturing of halons has been prohibited in the U.S. since 1994 **Montreal Protocol**
 - Halons are chlorinated or fluorinated hydrocarbons
 - Excellent extinguishing agents
 - Ozone-depleting chemicals
- New systems using existing stockpiles of halon are permitted
- Inspected annually including cylinders, hoses and releasing components
 - Hoses require a test every 5 years

Clean Agent Fire-extinguishing System

- A Clean Agent is defined as an “Electrically nonconducting, volatile or gaseous fire-extinguishant agent that does not leave a residue upon evaporation.”
- Clean agents are available in two formulations:
 - Halocarbons – formulated from organic compounds and fluorine, chlorine, bromine or iodine
 - Inert gas – formulated from nitrogen, argon, helium or neon. CO₂ may be used as a secondary agent
- All of the agents are liquefied compressed gases

Typical Design for a Clean Agent System Protecting a Computer Room

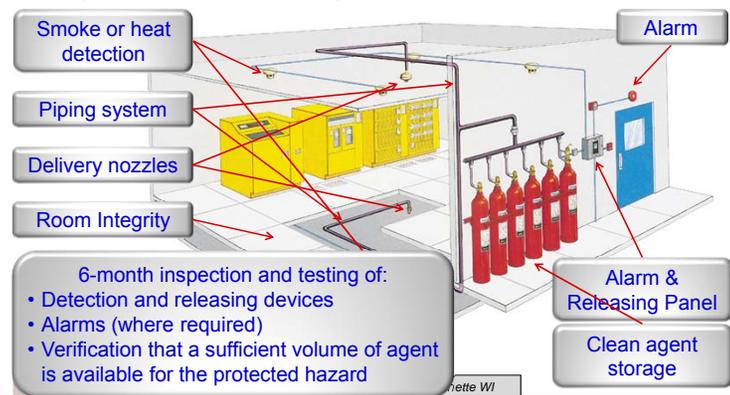

Water Mist Fire Protection Systems §904.11

- Systems designed in accordance with NFPA 750

NFPA 750 §3.3.19: A water spray for which the $Dv0.99$, for the flow-weighted cumulative volumetric distribution of water droplets, is less than 1,000 microns at the minimum design operating pressure of the water mist nozzle.



Water Mist Fire Protection Systems §904.11

- Systems designed in accordance with NFPA 750
- The systems are either pre-engineered or engineered for a specific hazard, such as engine-driven generators or large hydraulic systems
- Water mist systems are useful in areas with a limited water supply or when drainage and secondary containment features are limited.



Water Mist Fire Protection Systems

- 5-outlet water mist fire-extinguishing system designed to protect engine test cells



Water Mist Fire Protection Systems

- Water mist test on a hydrocarbon pool fire



Photograph courtesy of Securiplex LLC



Commercial Cooking Systems §904.12

- Commercial cooking systems shall be protected using:
 - Wet chemical listed to UL 300; or
 - Dry chemical listed to UL 300; or
 - Automatic sprinkler system listed for this application
- These systems must be installed in accordance with their listing and the manufacturer's installation instructions



Photo courtesy of Ansul Incorporated



Commercial Cooking Appliances

- Commercial cooking appliances defined:
 - Appliances used in a commercial food service establishment for heating or cooking food and which produce grease vapors, steam, fumes, smoke or odors that are required to be removed through a local exhaust ventilation system. Such appliances include deep fat fryers, upright broilers, griddles, broilers, steam-jacketed kettles, hot-top ranges, under-fired broilers (charbroilers), ovens, barbecues, rotisseries, and similar appliances. For the purpose of this definition, a food service establishment shall include any building or a portion thereof used for the preparation and serving of food.



Wet-Chemical Fire-extinguishing Systems




- These systems are installed in accordance with NFPA 17A, *Wet Chemical Extinguishing Systems*
- These systems must be listed to UL 300, *Fire Testing of Fire Extinguishing Systems for Protection of Restaurant Cooking Areas*



Wet-Chemical Fire-extinguishing Systems

- Wet-chemical fire-extinguishing system protecting a Type I single island cooking hood



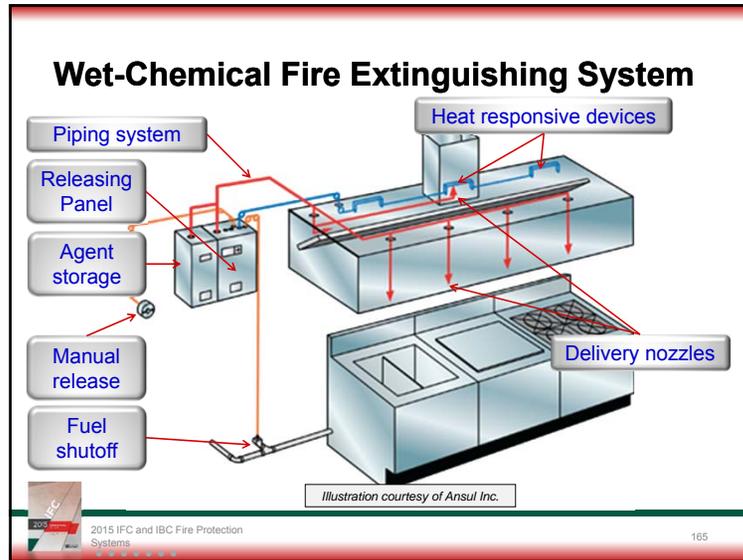

Inspection of Commercial Hoods

**Table 609.3.3.1
Commercial Cooking System Inspection Frequency**

Type Of Cooking Operation	Frequency of Inspection
High-volume cooking operations such as 24-hour cooking, charbroiling or wok cooking	3 months
Low-volume cooking operations such as places of religious worship, seasonal businesses and senior centers	12 months
Cooking operations utilizing solid-fuel burning cooking appliances	1 month
All other cooking operations	6 months

Photo courtesy of Flue Steam, Inc.

2015 IFC and IBC Fire Protection Systems 166

Portable Fire Extinguishers for Commercial Cooking Operations

- §904.12.5 requires portable fire extinguishers for commercial cooking systems
 - Listed Type K extinguisher
 - Travel distance ≤30'
 - Solid fuel appliances
 - One 2.5 gallon, or two 1.5 gallon
 - Deep fat fryers
 - One 1.5 gallon for 4 fryers, ≤80 lbs each
 - See manufacturer's instructions for fryers >6 ft²

Photo courtesy of Amerex Inc.

2015 IFC and IBC Fire Protection Systems 167

ACTIVITY Fire-extinguishing Systems

1. Can a dry-chemical fire-extinguishing system be used to increase the allowable height of a building?
2. How often must frangible bulb fusible links in a Type I hood be replaced?

2015 IFC and IBC Fire Protection Systems 168

ACTIVITY



Fire-extinguishing Systems

3. Which alternative fire-extinguishing agent does not leave residue once it evaporates?

- Dry chemical
- Wet chemical
- Aqueous film forming foam
- Clean agent



2015 IFC and IBC Fire Protection Systems 169

ACTIVITY



Fire-extinguishing Systems

4. What type of portable fire extinguisher is required for the protection of commercial cooking operations?

- Class B
- Class C
- Class D
- Class K



2015 IFC and IBC Fire Protection Systems 170



Module 5
Standpipe Systems



2015 IFC and IBC Fire Protection Systems 172

Standpipe Systems

§905.3

- Standpipes required in:
 - Buildings with a floor level >30' above LFLDVA
 - Buildings with a floor level >30' below HFLDVA
 - Group A with OL >1,000
 - Covered & open malls
 - Stages >1,000 ft²
 - Underground buildings
 - Marinas and boatyards



2015 IFC and IBC Fire Protection Systems 172

Standpipe Systems §202

- Standpipes are classified as follows:
 - Class I: designed for FD use only
 - Class II: designed for use by building occupants
 - Class III: designed for use by FD or building occupants

2½" hose connections

1½" hose connections with hose and nozzle

Combination of 2½" connections PLUS 1½" hose connections with hose and nozzle



Location of Class I Hose Valves §905.4


- In stair shafts, hose valves are required at intermediate landings unless otherwise approved by the FCO



Location of Class I Hose Valves §905.4


- In stair shafts, hose valves are required at intermediate landings unless otherwise approved by the FCO
- On each side of a horizontal exit

Hose valves not required when ≤130' from an exit stairway hose connection

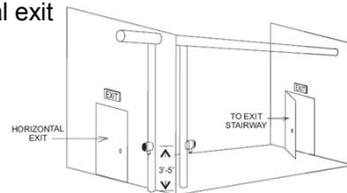


Location of Class I Hose Valves §905.4

- In stair shafts, hose valves are required at intermediate landings unless otherwise approved by the FCO
- On each side of a horizontal exit
- Adjacent to each public entrance to the mall and adjacent to each entrance from an exit passageway or exit corridor

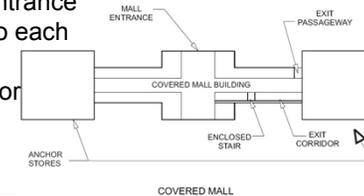

Interconnection of Standpipes §905.4.2, §905.6.2

- Where ≥ 2 Class I or III standpipes are in the same building or area they must be interconnected
- NFPA 14 requires interconnection of standpipes at the top of the building when the water supply or tank is at the top



2015 IFC and IBC Fire Protection Systems

177

Location of Class II Hose Connections §905.6.1

- Where Class II standpipe system is required throughout building, hose and valves must be accessible and distributed so all portions of the building are $\leq 100'$ hose with 30' hose stream
- Hose stations required in Group A-1 & A-2 occupancies with OL >1,000
 - Each side of stage
 - At rear of auditorium
 - Each side of balconies
 - Each tier of dressing rooms




2015 IFC and IBC Fire Protection Systems

178

Class III Standpipe at Stages

- Class III wet standpipe required at stages >1,000 ft²

Stage is a space in a building utilized for entertainment or presentations, and includes overhead hanging curtains, drops, scenery or stage effects other than lighting and sound.

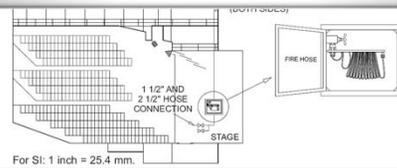

For SI: 1 inch = 25.4 mm.




2015 IFC and IBC Fire Protection Systems

179

Class III Standpipe at Stages

- Class III wet standpipe required at stages >1,000 ft²
- In sprinklered buildings, hose and nozzle is not required

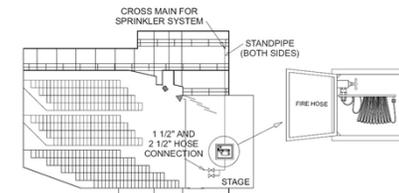

For SI: 1 inch = 25.4 mm.



2015 IFC and IBC Fire Protection Systems

180



Module 6
Fire Alarm and Detection Systems

Purpose of a Fire Alarm and Detection System

A fire alarm and detection system can be designed to perform several functions:

- Providing notification of an emergency
- Monitoring and notification of supervisory and trouble signals
- Alerting the occupants
- Summoning aid
- Controlling fire safety functions



Photo courtesy of Siemens Building Systems Inc.



Fundamental Components of a Fire Alarm and Detection System

- Fire Alarm Control Unit

Receives inputs from automatic and manual fire alarm devices and may be capable of supplying power to detection devices and transponders or off-premises transmitters. The control unit may be capable of providing a transfer of power to the notification appliances and transfer of condition to relays or devices.



Fundamental Components of a Fire Alarm and Detection System

- Fire Alarm Control Unit
- Alarm Notification Appliance

A fire alarm system component such as a bell, horn, speaker, light or text display that provides audible, tactile or visible outputs, or any combination thereof.



Fundamental Components of a Fire Alarm and Detection System


- Fire Alarm Control Unit
- Alarm Notification Appliance
- Initiating Devices

Originates transmission of a change-of-state condition, such as in a smoke detector, manual fire alarm box or supervisory switch.



Fire Alarm Systems Requirements §907.1

- Must comply with NFPA 72, *National Fire Alarm Code*
- All components must be listed and approved
- Design audibility level must be shown on plans
- Where fire detection is required, smoke detection is 1st choice
- Where heat detection is required, fire sprinklers can substitute for heat detectors



Group A §907.2.1

- Manual fire alarm system required where OL ≥ 300
- In sprinklered buildings, manual fire alarm boxes can be eliminated except for one



Group A-1, A-2, A-3 and A-4 will all require a fire sprinkler system when OL ≥ 300

Group A §907.2.1

- Manual fire alarm system required where OL ≥ 300
- In sprinklered buildings, manual fire alarm boxes can be eliminated except for one



When a required fire alarm system is installed in a building, ALL fire-extinguishing systems shall be monitored by FACU §904.3.5

Group A §907.2.1.1

- Emergency voice/alarm communication system is required in Group A with $OL \geq 1,000$
- This system must be connected to a source of emergency power



Group B §907.2.2

- Manual fire alarm required where:
 - $OL \geq 500$
 - ≥ 100 persons are located above or below LED
- In sprinklered buildings, manual fire alarm boxes can be eliminated except for one in an approved location



Group B Ambulatory Care Facility §907.2.2.1

- Manual fire alarm system required throughout the fire area containing an ACF
 - In sprinklered buildings, manual fire alarm boxes can be eliminated except for one in an approved location
- Smoke detection system required in ACF and all public areas including corridors and lobbies
 - Smoke detection can be eliminated in sprinklered buildings



Group E §907.2.3

- Manual fire alarm system required where $OL \geq 50$
- Emergency voice/alarm communication system required where $OL > 100$
- Manual fire alarm boxes are not required where:
 - Interior corridors are protected by smoke detectors
 - Smoke or heat detection is provided in auditoriums, cafeterias and gyms
- Manual fire alarm boxes are not required where:
 - Building is sprinklered and EVAC will activate upon waterflow

Group F §907.2.4

- Manual fire alarm required where:
 - ≥2 stories in height
 - OL ≥500 above or below the lowest LED
- In sprinklered buildings, manual fire alarm boxes can be eliminated except for one in an approved location



2015 IFC and IBC Fire Protection Systems

193

Group H §907.2.5

- Manual fire alarm required in:
 - Group H-5
 - Group H-2 or H-3 that manufacture organic coatings
- Smoke detection system required where storing
 - Highly toxic gases
 - Organic peroxides
 - Oxidizers



2015 IFC and IBC Fire Protection Systems

194

Group I §907.2.6

- Manual fire alarm system required in all Group I
 - Manual fire alarm boxes are permitted to be located at constantly attended locations, as long as travel distances are maintained
- Smoke detection system shall be installed in corridors and waiting areas open to corridors Group I-1
 - Smoke detection not required in sprinklered Group I-1 Condition 1



2015 IFC and IBC Fire Protection Systems

195

Group I-2 Condition 1 §907.2.6.2

- In addition to manual system, smoke detection is required in corridors and areas open to corridors
 - Corridor detection not required where sleeping units have smoke detectors that notify at nursing station
 - Corridor detection not required where sleeping unit doors are equipped with smoke-detector-activated door-closing device



Photo courtesy of
ASSA ABLOY Door Security Solutions



2015 IFC and IBC Fire Protection Systems

196

Group I-3 §907.2.6.3.3

- In addition to manual system, smoke detection system is required in housing areas, sleeping units, day rooms and other common spaces accessible to residents
 - Sleeping unit detectors not required in Group I-3 Use Condition 2 or 3
 - Sleeping unit detectors not required in where ≤4 residents and the building is sprinklered




Group M §907.2.7

- Manual fire alarm required where:
 - OL ≥500
 - ≥100 persons are located above or below LED
- Not required in covered or open malls
- In sprinklered buildings, manual fire alarm boxes can be eliminated except for one in an approved location
- Notification signal can go to normally attended location if emergency voice/alarm communication system is provided



Group R-1 §907.2.8.1

- Manual fire alarm system required
- Manual fire alarm system is **NOT** required where:
 - Building is ≤2 stories in height
 - Sleeping units, attics & crawl spaces have a minimum 1-HR separation
 - Each individual sleeping unit has an exit directly to a public way, exit court or yard

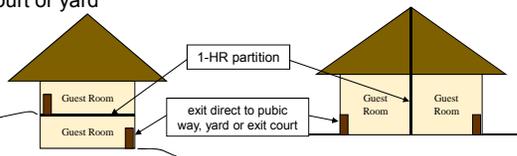

Group R-1 §907.2.8.1, Exc 2

- Manual fire alarm boxes are not required where:
 - Building is sprinklered with NFPA 13 or 13R
 - Notification appliances activate upon sprinkler flow
 - 1 manual fire alarm box is installed at an approved location



Group R-1 §907.2.8.2

- Smoke detection required in interior corridors serving sleeping rooms
 - Detection system is not required where the sleeping units have means of egress door opening directly to an exterior exit access



Group R-2 §907.2.9


- Manual fire alarm system required where:
 - Any dwelling unit is ≥ 3 stories above lowest LED
 - Any dwelling unit is located >1 story below the highest LED
 - Building houses >16 dwelling units or sleeping units



All but one manual fire alarm box can be eliminated when building is sprinklered with NFPA 13 or 13R

Group R-2 §907.2.9

- Manual fire alarm system required where:
 - Any dwelling unit is ≥ 3 stories above lowest LED
 - Any dwelling unit is located >1 story below the highest LED
 - Building houses >16 dwelling units or sleeping units

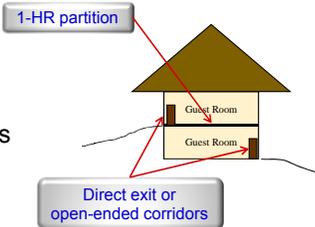

Manual fire alarm system is not required IF 1-HR partition separates all units and each unit has direct exit or exits through open-ended corridors

Group R-2 College & Univ. Buildings §907.2.9.3

- Smoke detection system is required in Group R-2 occupancies operated by a college or university for student or staff housing
 - Common spaces outside of dwelling and sleeping units
 - Laundry rooms, mechanical equipment rooms and storage rooms
 - Interior corridors serving sleeping or dwelling units

Detection system is not required in buildings without interior corridors

Smoke alarms in dwelling units and sleeping units SHALL be interconnected to fire alarm system

Group R-4 §907.2.10

- Manual fire alarm system is required

Manual fire alarm system is not required IF building ≤2-stories with 1-HR partitions separating all units and each unit has direct exit

Manual fire alarm boxes can be located at constantly attended locations, as long as travel distances are maintained

All but one manual fire alarm box can be eliminated when building is sprinklered with NFPA 13 or 13R



2015 IFC and IBC Fire Protection Systems 205

Group R-4 §907.2.10

- Manual fire alarm system is required
- Smoke detection system is required in corridors, waiting areas open to corridors, kitchens and common habitable areas

Smoke detection is not required in buildings sprinklered with NFPA 13

Smoke detection is not required if no interior corridors serving sleeping units and unit has exit to exterior



2015 IFC and IBC Fire Protection Systems 206

REFER TO



CODE BOOK

2015 IFC §202 Page 43

Special Amusement Buildings

A special amusement building represents a high fire and life safety challenge based on its definition:


A building that is temporary, permanent or mobile that contains a device or system that conveys passengers or provides a walkway along, around or over a course in any direction as a form of amusement arranged so that the egress path is not readily apparent due to visual or audio distractions or an intentionally confounded egress path, or is not readily available because of the mode of conveyance through the building or structure.



2015 IFC and IBC Fire Protection Systems 207

Special Amusement Buildings §907.2.12

- Smoke detection system required
 - Activate audible/visual alarms
 - Illuminate the means of egress
 - Shut off sound
 - Shut off visual distractions that confuse occupants
 - Activate approved directional exit marking
 - Activate pre-recorded message on emergency voice/alarm communication system




2015 IFC and IBC Fire Protection Systems 208

High-rise Buildings §907.2.13

- Smoke detection required in:
 - Air-handling systems
 - Mechanical equipment rooms
 - Elevator machine rooms
 - Elevator lobbies
- Emergency voice/alarm communication system required
- Emergency responder radio coverage
 - Fire department communication systems



2015 IFC and IBC Fire Protection Systems

209

Emergency Voice/Alarm Communication Systems §907.5.2.2

- System to deliver voice instructions on the floor of fire origin and the floor above and below the floor of fire origin
- Speakers are required to be designed as dedicated paging zones:
 - Elevator groups
 - Exit stairways
 - Each floor
 - Areas of refuge



2015 IFC and IBC Fire Protection Systems

210

Fire Alarm System Zones §907.6.4

- Each floor is zoned separately
 - $\leq 22,500$ ft², except for sprinkler systems
 - $\leq 300'$ in any direction
- In high-rise buildings each floor will have separate zones for:
 - Smoke detectors
 - Sprinkler water-flow devices
 - Manual fire alarm boxes
 - Other fire detection or suppression systems



2015 IFC and IBC Fire Protection Systems

211

Retroactive Fire Alarm Systems §1103.7

- If the following existing buildings do not have a fire alarm system, one must be installed:
 - Groups E, I-1, I-2, I-3, R-2
 - Group R-1 boarding and rooming houses
 - Group R-1 hotel and motel
 - Group R-4 residential care/assisted living facilities.
- Single- and multiple-station smoke alarms in Groups I-1 and R



2015 IFC and IBC Fire Protection Systems

212

Duct Smoke Detection §907.3.1

- When a fire alarm system is required, all extinguishing and detection systems must be connected to fire alarm system
- IMC §602 requires duct detection when:
 - Return air systems have a capacity >2,000 CFM
 - Common supply and return air systems have a capacity >2,000 CFM
 - Return air risers serving ≥2 stories have a design capacity >15,000 CFM



Photo courtesy of Air Products and Control, Inc.



2015 IFC and IBC Fire Protection Systems

213

Protection of Fire Alarm Control Unit §907.4.1

- When FACU is located in an area which is not in a continuously occupied area, it must be protected by:
 - A single smoke detector; or
 - A heat detector where ambient conditions are not favorable to smoke detectors
 - §907.4.3.1 states that a fire sprinkler can fulfill the service of a heat detector



2015 IFC and IBC Fire Protection Systems

214

Manual Fire Alarm Boxes §907.4.2

- Manual fire alarm boxes must:
 - Be located ≤5' from each exit
 - Have an exit access travel distance to manual fire alarm box of ≤ 200'
 - Have an activation handle located 42-48" AFF
 - Be red in color
 - Be equipped with listed protective covers if ordered by the FCC




2015 IFC and IBC Fire Protection Systems

215

Occupant Notification Systems §907.5

- Notification appliances are required in most occupancies
 - Audible
 - Visual
 - Tactile
 - Any combination thereof
- Notification must occur upon activation of a fire detector, sprinkler flow, a manual fire alarm box or an automatic fire-extinguishing system



2015 IFC and IBC Fire Protection Systems

216

Audible Alarms §907.5.2

- 15 dBA above ambient sound level
- Maximum sound pressure level permitted is 110 dBA
- Minimum required sound pressure level for all appliances and for certain areas of buildings



Visual Alarms §907.5.2.3.1

- Visual alarms in:
 - Public areas
 - Common areas
 - Sleeping units and dwelling units of Groups I-1 and R-1



Visual Alarms §907.5.2.3.1

- Visual alarm notification appliances designed with a $\geq 20\%$ spare capacity for future visual alarms
- | | Number of Sleeping Units | Sleeping Accommodations with Visible Alarms |
|-----|--------------------------|---|
| ▪ P | 6 to 25 | 2 |
| ▪ C | 26 to 50 | 4 |
| ▪ S | 51 to 75 | 7 |
| ur | 76 to 100 | 9 |
| | 101 to 150 | 12 |
| | 151 to 200 | 14 |
| | 201 to 300 | 17 |
| | 301 to 400 | 20 |
| | 401 to 500 | 22 |
| | 501 to 1,000 | 5% of total |
| | 1,001 and over | 50 plus 3 for each 100 over 1,000 |



Visual Alarms §907.5.2.3.1

- Visual alarms in:
 - Public areas
 - Common areas
 - Sleeping units and dwelling units of Groups I-1 and R-1
- Employee work areas with audible alarms shall have the notification appliance circuit designed with a $\geq 20\%$ spare capacity for future visual alarms

All dwelling units and sleeping units in Group R-2 shall be provided with the capability to support visible alarm notification appliances



Monitoring §907.6.6

- All required fire alarm systems to be monitored by an approved supervising station
- Supervision is not required for:
 - Smoke alarms or smoke detectors in Group I-3
 - Automatic sprinklers in 1- and 2-family dwellings
 - Smoke alarms



Photo courtesy of Property Protection Inc.

Inspection, Testing and Maintenance §907.8


- Acceptance testing of fire detection and alarm systems is required at time of installation
- Additional/routine testing in accordance with the schedules in NFPA 72
- Written records of the maintenance, inspection and testing
- Records to be maintained and made available to FCO upon request



Where Smoke Alarms Are Required §907.2.11


- Smoke alarms are required in:
 - Groups R-1, R-2, R-3 R-4 and I-1

- Smoke alarms comply with UL 217
- Smoke detectors comply with UL 268

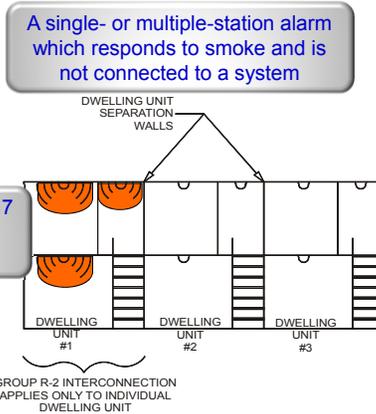

Where Smoke Alarms Are Required §907.2.11

- Smoke alarms are required in:
 - Groups R-1, R-2, R-3 R-4 and I-1
- In new occupancies, detectors must be connected to a branch circuit with a battery backup power supply
- Interconnection when ≥ 1 device

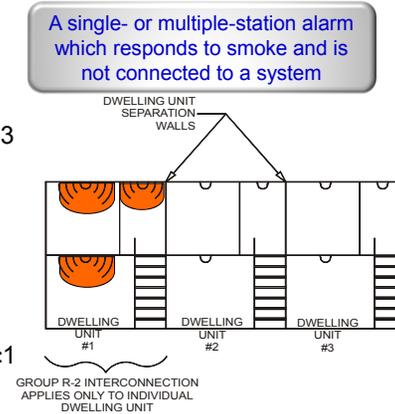

Smoke Alarms near Cooking Appliances and Bathrooms - §907.2.11.3, §907.2.11.4

- Criteria for locating smoke alarms in relation to cooking appliances

ionization smoke alarm

Minimum 20'

2015 IFC and IBC Fire Protection Systems 225

Smoke Alarms near Cooking Appliances and Bathrooms - §907.2.11.3, §907.2.11.4

- Criteria for locating smoke alarms in relation to cooking appliances

ionization smoke alarm with alarm silencing

Minimum 10'

2015 IFC and IBC Fire Protection Systems 226

Smoke Alarms near Cooking Appliances and Bathrooms - §907.2.11.3, §907.2.11.4

- Criteria for locating smoke alarms in relation to cooking appliances

Photoelectric smoke alarm

Minimum 6'

2015 IFC and IBC Fire Protection Systems 227

Smoke Alarms near Cooking Appliances and Bathrooms - §907.2.11.3, §907.2.11.4

- Criteria for locating smoke alarms in relation to cooking appliances
- Criteria for locating smoke alarms in relation to bathrooms
- Proper location of smoke alarms can help reduce the number of nuisance alarms

Bedroom

Bedroom

Bathroom with Tub or Shower

3 feet or greater (0.91m)

Smoke Alarm

2015 IFC and IBC Fire Protection Systems 228

Emergency Alarm Systems §908

- Emergency alarm systems required for:
 - Group H-5
 - Indoor storage & use areas of highly toxic or toxic gases as required by §6004.2.2.10
 - Ozone gas-generator rooms
 - Repair garages for vehicles fueled with a nonodorized gas
 - Refrigeration systems



Emergency alarms are systems to provide indication and warning of emergency situations involving hazardous materials

2015 IFC and IBC Fire Protection Systems 229

Carbon Monoxide Alarms §915, §1103.9

- CO alarms required in:
 - Groups I-1, I-2, I-4 and R
 - Group E classrooms
- IF:
 - Fuel-burning appliances
 - Force air furnace with fuel-burning appliance
 - Attached private garage



Public garages are regulated under IBC §406 and provided with ventilation

2015 IFC and IBC Fire Protection Systems 230

Carbon Monoxide Alarms §915, §1103.9

- CO alarms required in:
 - Groups I-1, I-2, I-4 and R
 - Group E classrooms
- IF:
 - Fuel-burning appliances
 - Force air furnace with fuel-burning appliance
 - Attached private garage
- Could be CO alarm or CO detection system



Only retroactive for these occupancies

2015 IFC and IBC Fire Protection Systems 231

ACTIVITY Fire Alarm and Detection Systems

- What is the component in a fire alarm and detection system that recognizes a change of state or condition?
- What IFC chapter contains the retroactive requirements for fire alarm systems?

2015 IFC and IBC Fire Protection Systems 232

ACTIVITY



Fire Alarm and Detection Systems

3. Which occupancies/facilities require an emergency alarm/voice communications system?

4. T F CO alarms are required in all rooms of Group E occupancies.



2015 IFC and IBC Fire Protection Systems 233



Module 7
Smoke Management

Smoke Management Systems §909, §910

- Two concepts of handling smoke in the code
 - §909 – Smoke Control Systems

These systems are designed to maintain a tenable atmosphere for occupants during an evacuation



2015 IFC and IBC Fire Protection Systems 235

Smoke Management Systems §909, §910

- Two concepts of handling smoke in the code
 - §909 – Smoke Control Systems
 - §910 – Smoke and Heat Removal

These systems are designed to remove smoke from buildings in large Group F and S occupancies



2015 IFC and IBC Fire Protection Systems 236

Smoke Management Systems §909, §910

- Two concepts of handling smoke in the code
 - §909 – Smoke Control Systems
 - §910 – Smoke and Heat Removal
- These systems are not the same
 - Both provide for improved fire fighter safety, enhance fire-fighting operations, reduce property damage
 - Smoke Control System's main function is for life safety



Required Smoke Control Systems

- IBC §402.7.2 – covered malls constructed as an atrium >2 stories in height
- IBC §404.5 – atriums
- IBC §405.5 – underground buildings
- IBC §408.9 – windowless buildings
- IBC §410.3.7.2 – stage >1,000 ft²
- §1029.6.2.1 – smoke-protected assembly seating
- §1023.11 – smokeproof enclosures



Types of Smoke Control Systems

- 3 methods of smoke control:
 - Smoke barrier construction – can be either active or passive
 - Pressurization method – provides a differential pressure across smoke barriers. It is permitted in sprinklered or nonsprinklered buildings.
 - Exhaust method – allows for the exhausting of large volume atmospheres. The design must comply with NFPA 92 and limits the smoke layer depth to 6' above the egress walking path within the smoke zone



Types of Smoke Control Systems

- 3 methods of smoke control:
 - Smoke barrier construction – can be either active or passive
 - Pressurization method – provides a differential pressure across smoke barriers. It is permitted in sprinklered or nonsprinklered buildings.
 - Exhaust method – allows for the exhausting of large volume atmospheres. The design must comply with NFPA 92 and limits the smoke layer depth to 6' above the egress walking path within the smoke zone
- These systems are engineered for a specific building and specific purpose
 - Each system will have distinct components and design
 - Systems need to be commissioned and inspected in accordance with the design documents



Smoke and Heat Removal

- Smoke and heat removal required in:
 - Group F-1 and S-1 >50,000 ft²
 - High-piled storage where required by Table 3206.2

Not required:

- In frozen food warehouses with Class I or II commodities
- Where ESFR sprinklers are installed
- Where CMSA sprinklers with RTI ≤50 are installed

2015 IFC and IBC Fire Protection Systems
241

Smoke and Heat Removal

- Smoke and heat removal required in:
 - Group F-1 and S-1 >50,000 ft²
 - High-piled storage where required by Table 3206.2
- A smoke and heat removal can be accomplished by either:
 - Smoke/heat vents, or
 - Mechanical smoke removal system

2015 IFC and IBC Fire Protection Systems
242

Smoke and Heat Removal §910

- Selection of smoke & heat removal method

Method of Smoke & Heat Removal	Sprinklered Building	Nonsprinklered Building	1 st Story with Stories Above
Smoke/Heat Vents	Option 1	Required	Not allowed
Mechanical Smoke Removal	Option 2	Not allowed	Required

2015 IFC and IBC Fire Protection Systems
243

Smoke/Heat Vents

- Smoke/heat vents are:
 - Located on the roof of the building
 - Operate automatically and manually

Photo courtesy of Bilco Corporation

2015 IFC and IBC Fire Protection Systems
244

Smoke/Heat Vents

- Sn
-
-

Photo courtesy of Bilco Corporation

245

Smoke/Heat Vents

- Sn
-
-
- Au of sn

Photo courtesy of Bilco Corporation

246

Smoke/Heat Vents

- Sn
-
-
- Au of sn

Photo courtesy of Bilco Corporation

247

Smoke/Heat Vents

- Smoke/heat vents are:
 - Located on the roof of the building
 - Operate automatically and manually
 - Mechanically operated, or
 - Gravity operated

tion the

248

Smoke/Heat Vents

- Smoke/heat vents are:
 - Located on the roof of the building
 - Operate automatically and manually
 - Mechanically operated, or
 - Gravity operated



Smoke/Heat Vents

- Smoke/heat vents are:
 - Located on the roof of the building
 - Operate automatically and manually
 - Mechanically operated, or
 - Gravity operated

Design option

Smoke/Heat Vents

- Smoke/heat vents are:
 - Located on the roof of the building
 - Operate automatically and manually
 - Mechanically operated, or
 - Gravity operated
- Automatic operation must not require connection of electrical power or other energy source to the smoke and heat vent

Smoke and Heat Removal §910

- Smoke/heat vents
 - Calculation for sprinklered building
 - $A_{VR} = V/9000$

NOTE: formula is based on volume; no longer based on floor area



Smoke and Heat Removal §910

- Smoke/heat vents
 - Calculation for sprinklered building
 - $A_{VR} = V/9000$

- A_{VR} = the aggregate vent area required
- V = the volume of the area to be vented



Smoke and Heat Removal §910

- Smoke/heat vents
 - Calculation for sprinklered building
 - $A_{VR} = V/9000$
 - Calculation for unsprinklered building
 - $A_{VR} = V/50$

- A_{VR} = the aggregate vent area required
- V = the volume of the area to be vented



Smoke/Heat Vents

- Calculation for sprinklered building
 - 400,000 ft² warehouse
 - Ceiling/roof height = 36'
 - $400,000 \times 36 = 14,400,000 \text{ ft}^3$
 - $14,400,000 \div 9,000 = 1,600 \text{ ft}^2$ of vent area
 - 4' x 8' Smoke/heat vent = 32 ft²
 - $1,600 \div 32 = 50$ vents

$$A_{VR} = V \div 9000$$



Photo courtesy of Bilco, Inc.



Smoke and Heat Removal §910

- Mechanical smoke removal
 - 2 air changes per hour
 - Based on empty building
 - Makeup air openings $\leq 6'$ of floor
 - Automatic shutdown upon sprinkler operation
 - Manual controls in room accessible from the exterior with 1-HR separation



ACTIVITY

Smoke/Heat Vents

Given:

1. Building area: 65,000 ft²
2. Storage Height: 21'
3. Ceiling Height: 27'
4. High-piled Storage: Yes
5. Commodity: Class IV
6. Area of each smoke and heat vent: 32 ft²
7. Building is sprinklered



2015 IFC and IBC Fire Protection Systems 257

ACTIVITY


Smoke/Heat Vents

Determine smoke/heat vent requirements

Is this design acceptable?

$$A_{VR} = V \div 9000$$

1. Volume = 65,000 X 27
2. Volume = 1,755,000 ft³
3. $A_{VR} = V \div 9000$
4. $A_{VR} = 1,755,000 \div 9000$
5. $A_{VR} = 195 \text{ ft}^2$
6. Smoke/heat vent = 32 ft²
7. $195 \div 32 = 6.09$ vents
8. Therefore 7 vents required

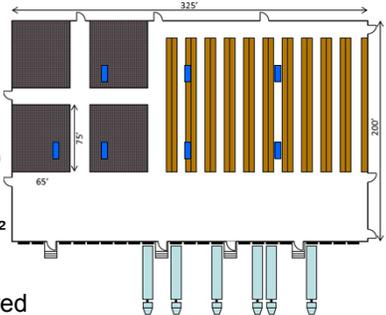

2015 IFC and IBC Fire Protection Systems 258

Smoke/Heat Vents §910.3

- Vents listed to UL 793 or FM 4430
- Gravity drop out vents must operate after a 5-minute exposure to temperature of 500°F
- Activation temperature is not specified in the IFC
 - FM specifies that vents should be ≤100°F above the sprinkler operating temperature
- Smoke/heat vents ≥16 ft²
- Located ≥20' from property lines and ≥10' from fire barriers or fire walls

2015 IFC and IBC Fire Protection Systems 259

ACTIVITY

Mechanical Smoke Removal

Given:

1. Building area: 65,000 ft²
2. Storage Height: 21'
3. Ceiling Height: 27'
4. High-piled Storage: Yes
5. Commodity: Class IV
6. Exhaust fans rated at 30,000 CFM
7. Building is sprinklered



2015 IFC and IBC Fire Protection Systems 260

ACTIVITY

Mechanical Smoke Removal

Determine smoke/heat vent requirements
Ventilation = 2 air changes/hour

1. Volume = 65,000 X 27
2. Volume = 1,755,000 ft³
3. CFH = 2 X 1,755,000
4. CFH = 3,510,000 ft³
5. CFM = 3,510,000 ÷ 60
6. CFM = 58,500
7. 58,500 ÷ 30,000 = 1.95 fans

2015 IFC and IBC Fire Protection Systems 261

ACTIVITY

Mechanical Smoke Removal

Determine smoke/heat vent requirements
Ventilation = 2 air changes/hour

1. Volume = 65,000 X 27
2. Volume = 1,755,000 ft³
3. CFH = 2 X 1,755,000
4. CFH = 3,510,000 ft³
5. CFM = 3,510,000 ÷ 60
6. CFM = 58,500
7. 58,500 ÷ 30,000 = 1.95 fans

1-HR control room accessible from exterior door

2015 IFC and IBC Fire Protection Systems 262

ACTIVITY

Mechanical Smoke Removal

Determine smoke/heat vent requirements
Ventilation = 2 air changes/hour

1. Volume = 65,000 X 27
2. Volume = 1,755,000 ft³
3. CFH = 2 X 1,755,000
4. CFH = 3,510,000 ft³
5. CFM = 3,510,000 ÷ 60
6. CFM = 58,500
7. 58,500 ÷ 30,000 = 1.95 fans
8. Makeup air = 8 ft² per 1,000 CFM

293 ft² required

Makeup air openings

2015 IFC and IBC Fire Protection Systems 263

FINAL REFLECTION

Final Reflection

- Summary
- Questions and Answers

2015 IFC and IBC Fire Protection Systems 264

International Code Council is a Registered Provider with The American Institute of Architects Continuing Education Systems. Credit earned on completion of this program will be reported to CES Records for AIA members. Certificates of Completion for non-AIA members are available on request.

This program is registered with the AIA/CES for continuing professional education. As such, it does not include content that may be deemed or construed to be an approval or endorsement by the AIA of any material of construction or any method or manner of handling, using, distributing, or dealing in any material or product. Questions related to specific materials, methods, and services will be addressed at the conclusion of this presentation.



Copyright Materials

This presentation is protected by US and International Copyright laws. Reproduction, distribution, display and use of the presentation without written permission of the speaker is prohibited.

© International Code Council 2016



Thank you for participating

To schedule a seminar, contact:

The ICC Training & Education Department
1-888-ICC-SAFE (422-7233) Ext. 33818

or

E-mail: icctraining@iccsafe.org